FIRST ANGLE PROJECTION

(ALL DIMENSIONS ARE IN mm)

DRG. NO. HY-DG-1-31701-14176 SHT. 1 OF 1

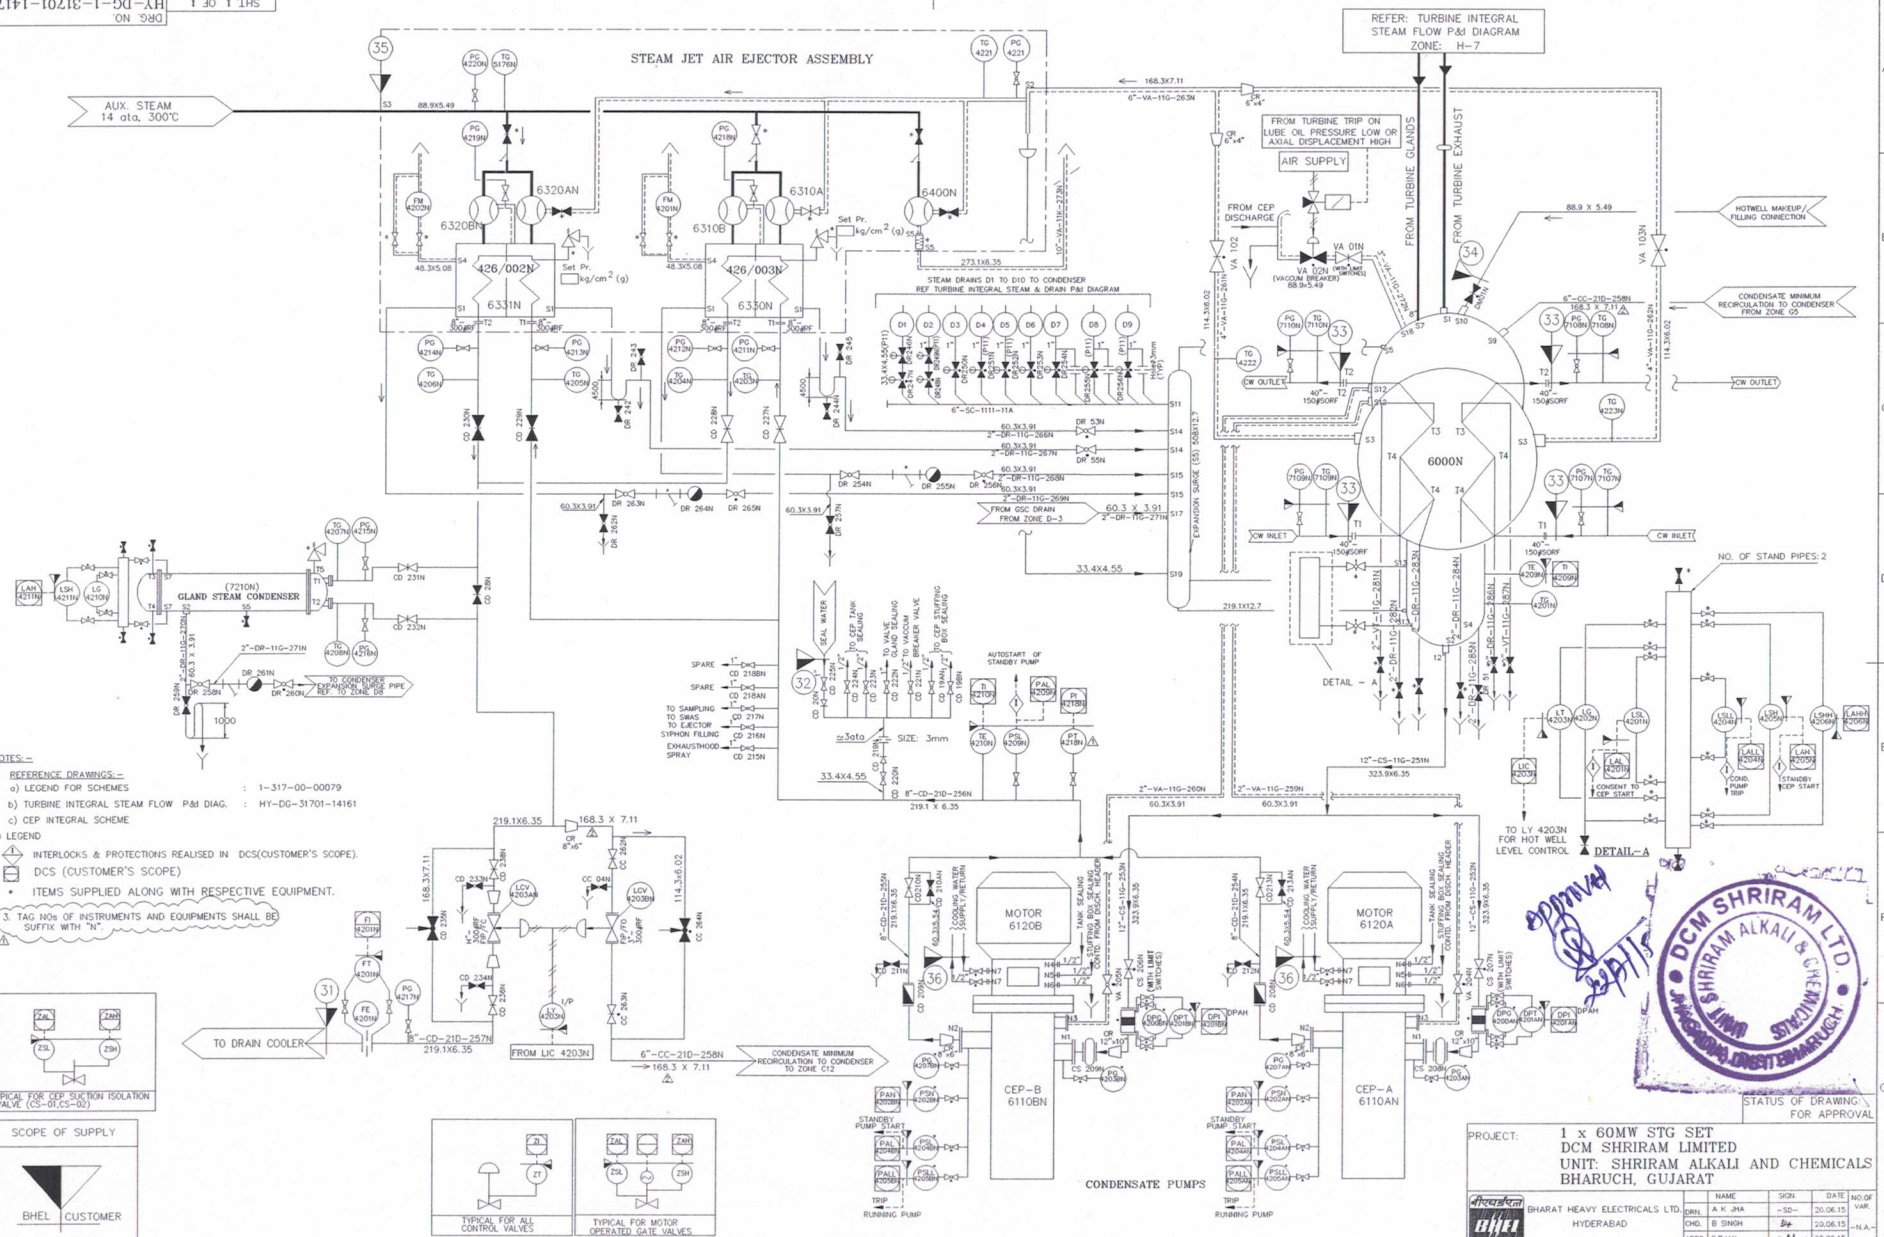


NOTES:-

1) REFERENCE DRAWINGS:-
   a) LEGEND FOR SCHEMES : 1-317-00-00079
   b) TURBINE INTEGRAL STEAM FLOW P&d DIAG. : HY-DG-31701-14161
   c) CEP INTEGRAL SCHEME
2) LEGEND
   - INTERLOCKS & PROTECTIONS REALISED IN DCS(CUSTOMER'S SCOPE).
   - DCS (CUSTOMER'S SCOPE)
   - * ITEMS SUPPLIED ALONG WITH RESPECTIVE EQUIPMENT.
3. TAG NOs OF INSTRUMENTS AND EQUIPMENTS SHALL BE SUFFIX WITH "N".

TYPICAL FOR CEP SUCTION ISOLATION VALVE (CS-01,CS-02)

SCOPE OF SUPPLY

| BHEL | CUSTOMER |
|---|---|

TYPICAL FOR ALL CONTROL VALVES

TYPICAL FOR MOTOR OPERATED GATE VALVES

THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPANY

COMPUTER FILE NAME | REF. DRG. NO. | SIGN. AND DATE | INVENTORY NO

| REV. | DATE | ALTERED | CHD/APPD | ZONE |
|---|---|---|---|---|
| 02 | 15.07.15 | AKJ | CHD/APPD BSINGH/SRVK | Minimum Recirculation Line updated. Nozzle number updated as per CA drawing and marked as 1 |
| 01 | 30.06.15 | AKJ | CHD/APPD BSINGH/SRVK | Revised as per M/s SAC comments. and marked as 1 |

DEPT. TAC CODE 415 | UNTOL DIMS. ±0.5/1.0 | SCALE N.T.S. | WEIGHT (KG) -N.A- | REF. TO ASSY. DRG. -N.A- | ITEM NO. -N.A- | NO. OF ITEMS -N.A-

BHARAT HEAVY ELECTRICALS LTD. HYDERABAD

| | NAME | SIGN. | DATE | NO. OF VAR. |
|---|---|---|---|---|
| DRN. | A K JHA | -SD- | 20.06.15 | -N.A- |
| CHD. | B SINGH | | 20.06.15 | |
| APPD. | S.R.V.K | | 20.06.15 | |

STATUS OF DRAWING: FOR APPROVAL

PROJECT: 1 x 60MW STG SET
DCM SHRIRAM LIMITED
UNIT: SHRIRAM ALKALI AND CHEMICALS
BHARUCH, GUJARAT

TITLE: CONDENSATE FLOW P&I DIAGRAM

CARD CODE | DRAWING NO. HY-DG-1-31701-14176 | REV. 02 | SHT. No. 1 | NO. OF SHT. 1

DCM SHRIRAM LTD. SHRIRAM ALKALI & CHEMICALS JHAGADIA GIDC BHARUCH