 PEM :: C&I	STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL	STD QUALITY PLAN NO.: PE-QP-999-145-1056
		VOLUME IIB
		SECTION D
		REV. NO. 01 DATE: 22-02-2008
		SHEET 5 OF 7


Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Agency \$			Remarks	
								Format of Records	P	W		V
10.	Panel Wiring	<ol style="list-style-type: none"> 1. Wiring Layout 2. Wiring Termination (Crimped Lugs) 3. Ferrule numbers 4. Colour of wiring 5. Size of Conductor 	MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
			MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
			MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
			MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	1	
			MA	Measurement	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	1	
11.	Component Mounting	<ol style="list-style-type: none"> 1. Correct components 2. Fixing 	MA	Visual	100%	Approved drgs., Specs. & BOM	Approved drgs., Specs. & BOM	Log Book	2	---	---	
			MA	Visual	100%	Approved drgs., Specs. & BOM	Approved drgs., Specs. & BOM	Log Book	2	---	---	
12.	FINAL Final Inspection	1. Workmanship	MA	Visual	100%	Factory Standard	Factory Standard	Inspection Report	2	1	1	At Random by BHEL, based on 100 % internal test reports by Mfr.
		2. Component layout (neatness, accessibility & safety) Mounting / Proper fixing of all components	MA	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
		3. Components identification Marking / Name plates	MA	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	

LEGEND: * CR - Critical characteristics
 MA - Major characteristics
 MI - Minor characteristics

\$

P - Agency Performing the Test.
 W - Agency Witnessing the Test.
 V - Agency Verifying the Test.

1 - BHEL
 2 - Vendor
 3 - Sub-vendor


 STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL		STD QUALITY PLAN NO.: PE-QP-999-145-1056						
		VOLUME		IIB				
		SECTION		D				
		REV. NO.		01		DATE: 22-02-2008		
		SHEET		6		OF 7		

Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency \$			Remarks
									P	W	V	
		5. Dimensions	MA	Measurement	100%	BHEL approved drg. / Spec., BOM	BHEL approved drg. / Spec., BOM	Inspection Report	2	1	1	At Random by BHEL, based on 100 % internal test reports by Mfr.
		6. Door functioning	MA	Functional	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
		7. Paint Shade	CR	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
		8. Paint Thickness	CR	Measurement	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
		9. Workmanship of Gaskets	MA	Visual	100%	Factory Standard	Factory Standard	Inspection Report	2	1	1	
		10. Wiring Layout	MA	Visual	100%	BHEL approved drg.	BHEL approved drg.	Inspection Report	2	1	1	
		11. Wire Termination	MA	Pulling manually	Sample	----	Firm termination	Inspection Report	2	1	1	
		12. Continuity	MA	Electrical	100%	----	Continuity OK	Inspection Report	2	1	1	

LEGEND: * CR - Critical characteristics
 MA - Major characteristics
 MI - Minor characteristics

\$ P - Agency Performing the Test.
 W - Agency Witnessing the Test.
 V - Agency Verifying the Test.

1 - BHEL
 2 - Vendor
 3 - Sub-vendor

 STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL		STD QUALITY PLAN NO.: PE-QP-999-145-1056						
		VOLUME IIB						
		SECTION D						
		REV. NO. 01 DATE: 22-02-2008						
		SHEET 7 OF 7						

Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency \$			Remarks
									P	W	V	
13.	TYPE TEST	Degree of Protection	CR	Mech. Protection	Sample	BHEL approved spec., drg relevant IEC-60947, IEC-60079	BHEL approved spec., drg relevant IEC-60947, IEC-60079	Type Test Certificate	3	---	1	
14	ROUTINE TEST	IR before & after HV Test	CR	Electrical	100%	BHEL approved spec., drg., BOM & relevant standard	BHEL approved spec., drg., BOM & relevant standard	Test Report	2	1	1	
15	FUNCTIONAL TEST	1. Control Logic Operation 2. Instrument Calibration 3. Temperature rise	CR	Electrical	100%	BHEL approved spec. / drg.	BHEL approved spec. / drg.	Inspection Report	2	1	1	
			CR	Electrical	10%	BHEL approved spec. / drg.	BHEL approved spec. / drg.	Inspection Report	2	1	1	
			CR	Electrical	100%	BHEL approved spec./drg. & relevant standard	BHEL approved spec/drg & relevant standard	Inspection Report	2	1	1	

LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics	\$ P - Agency Performing the Test. W - Agency Witnessing the Test. V - Agency Verifying the Test.	1 - BHEL 2 - Vendor 3 - Sub-vendor
--	---	--



Technical specification for
CONTROL & INSTRUMENTATION
5x800 MW YADADRI TPS, NALGONDA

SPEC NO.: **PE-TS-417-145-I**

VOLUME

SECTION

REV. NO. 00





DATE : 02.07.2020


SHEET OF

CABLE BOQ

CABLE SIZES FOR 5X800 MW YADADRI TPS	
Sl no.	Cable Type
	G-TYPE
1	2P X 0.5 sqmm
2	4P X 0.5 sq mm
3	8P X 0.5 sqmm
4	12P X 0.5 sqmm
5	2P X 1.5 sqmm
	F-TYPE
1	4P X 0.5 sqmm
2	8P X 0.5 sqmm
3	12P X 0.5 sqmm
4	20P X 0.5 sqmm
	CONTROL CABLE
1	3C X 2.5 sqmm
2	5C x 2.5 sq mm
3	12C x 2.5 sqmm

INSTRUMENT STUB DETAILS

					CUSTOMER:  TELANGANA STATE POWER GENERATION CORPORATION LTD TELANGANA, INDIA 5 x 800 MW YADADRI TPS, UNIT # 1 TO 5								
					CONSULTANT:  TATA CONSULTING ENGINEERS LIMITED BANGALORE, INDIA								
JOB NO. 417 STATUS CONTRACT DISTRIBUTION					 BHARAT HEAVY ELECTRICALS LTD POWER SECTOR PROJECT ENGINEERING MANAGEMENT NOIDA								
					COPY RIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED it must not be used directly or indirectly in any way detrimental to the interest of the company.								
REV.	DATE	ALTD	CHD	APPD	REV.	DATE	ALTD	CHD	APPD	DEPT CODE	NAME	SIGN	DATE
										I	DRN AKS		20.01.18
											DESIN AKS		20.01.18
											CHD RKR		20.01.18
											APPD SSB		20.01.18
TITLE										INSTRUMENT STUB DETAILS			
										DEPT.	SCALE	DRAWING NO.	
										SIGN		PE-DG-417-145-1101	
										SHEET 1 OF 6		REV. 00	

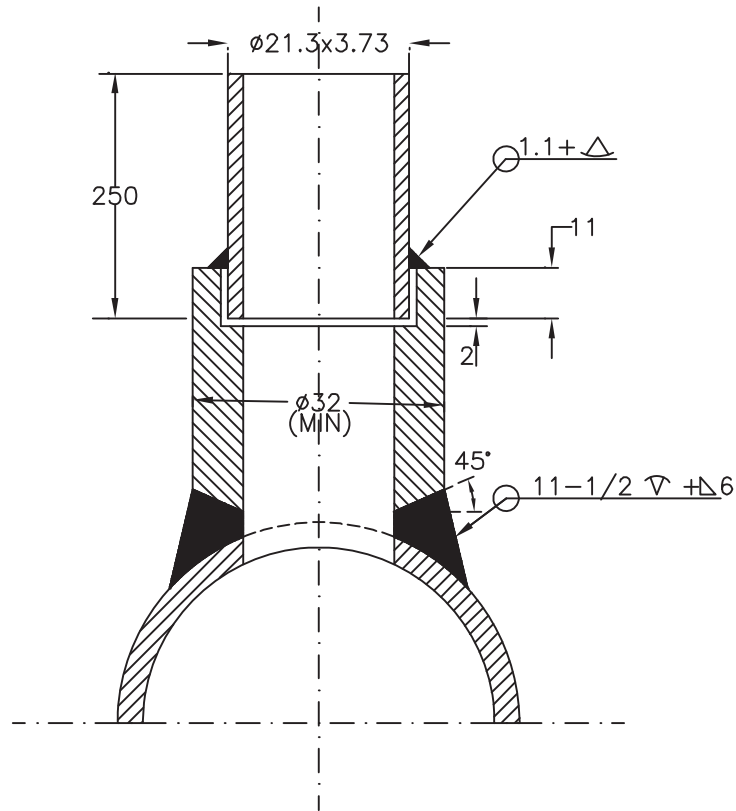

NOTE :


1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFORM TO ANSI B16.11.
2. THE LENGTH OF NIPPLE SHALL BE 250 MM.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1/2" GLOBE VALVE OF MATERIAL AS PER ANSI B 31.1.
4. TWO ISOLATION VALVES ARE TO BE USED FOR PRESSURE EXCEEDING 40 Kg/Cm2.
5. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
6. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY(1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.



TITLE : 5 x 800 MW YADADRI TPS
 STD INSTRUMENT STUB
 DETAILS
 PRESSURE STUB

DRG. NO.
 PE-DG-417-145-1101
 REV. 00
 SH. 02 OF 06

SYSTEM PRESS < 60Kg/Cm2 & SYSTEM TEMP<425 Deg C, Nb15 , CL3000

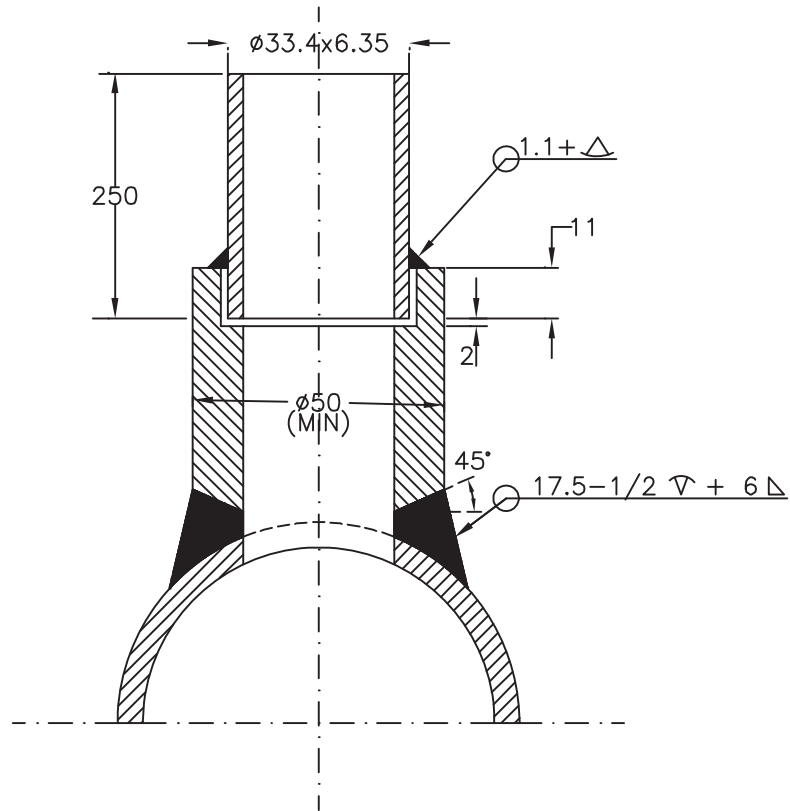

NOTE :


1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFORM TO ANSI B16.11.
2. THE LENGTH OF NIPPLE SHALL BE 250 MM.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 31.1.
4. TWO ISOLATED VALVES ARE TO BE USED.
5. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
6. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY(1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.



TITLE : 5 x 800 MW YADADRI TPS
 STD INSTRUMENT STUB
 DETAILS
 PRESSURE STUB

DRG. NO.
 PE-DG-417-145-1101
 REV. 00
 SH. 03 OF 06

SYSTEM PRESS > 60Kg/Cm2 & 425 Deg C < SYSTEM TEMP <= 500 Deg C , Nb25 , CL3000/6000

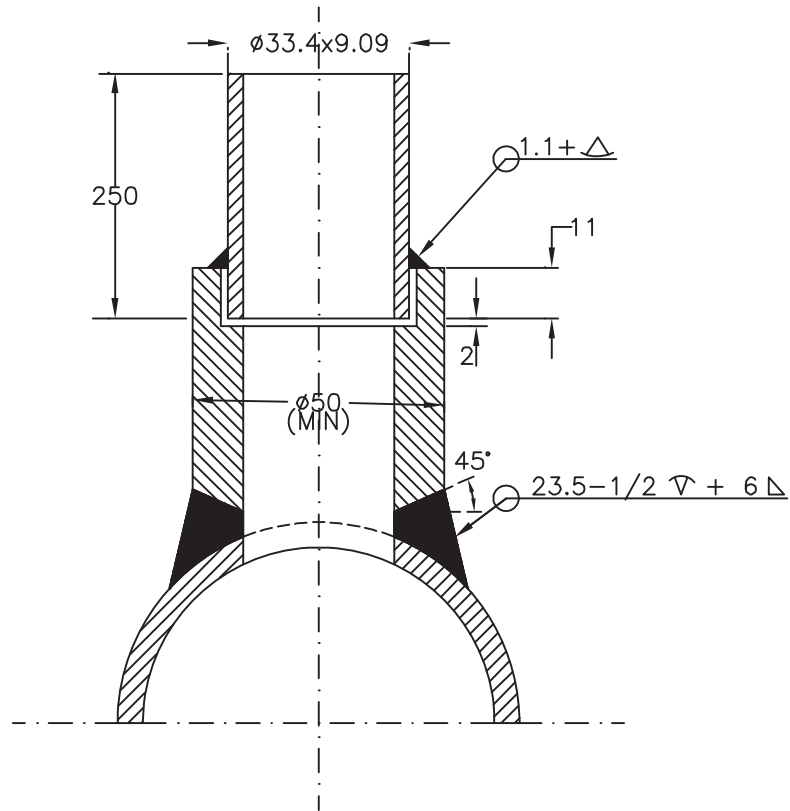


NOTE :

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFORM TO ANSI B16.11.
2. THE LENGTH OF NIPPLE SHALL BE 250 MM.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 31.1.
4. TWO ISOLATED VALVES ARE TO BE USED.
5. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
6. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY(1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.




TITLE : 5 x 800 MW YADADRI TPS
 STD INSTRUMENT STUB
 DETAILS
 PRESSURE STUB
 SYSTEM TEMP > 500 Deg C , Nb25 , CL9000

DRG. NO.
 PE-DG-417-145-I101
 REV. 00
 SH. 04 OF 06

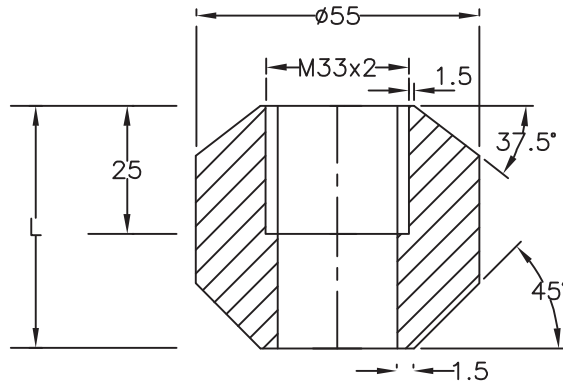

TEMPERATURE STUB FOR STRAIGHT IMMERSION

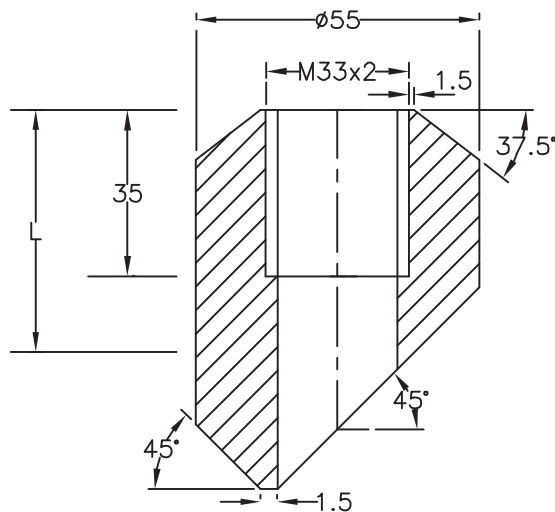

TEMPERATURE STUB FOR SLANT IMMERSION

NOTE :


1. MATERIAL OF THE BOSS SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED.
2. LENGTH OF THE STUB (L) SHALL BE 64/45 mm DEPENDING UPON PIPE SIZE, AS PER CORPORATE STD. AA 7326102.(FOR PIPE OD 88.9 mm TO 159 mm STUB HEIGHT SHALL BE=64mm & FOR PIPE OD ≥ 219.1 mm STUB HEIGHT SHALL BE=45mm)
3. STRAIGHT IMMERSION STUBS SHALL BE USED FOR PIPE OD'S 168.3 mm & ABOVE. THE STUB HEIGHT FOR PIPE OD 168.3 mm TO < 219.1 mm SHALL BE 64 mm.
4. SLANT IMMERSION STUBS SHALL BE USED FOR PIPE OD'S 88.9 mm TO 159 mm.
5. FOR MAIN PIPE OD'S 88.9 mm & BELOW SUITABLE EXPANDER SHALL BE USED.
6. PLEASE REFER SHEET-6 FOR THERMOWELL INSTALLATION.



TITLE : 5 x 800 MW YADADRI TPS
STD INSTRUMENT STUB
DETAILS


TEMPERATURE STUB

DRG. NO.
PE-DG-417-145-1101
REV. 00
SH. 05 OF 06

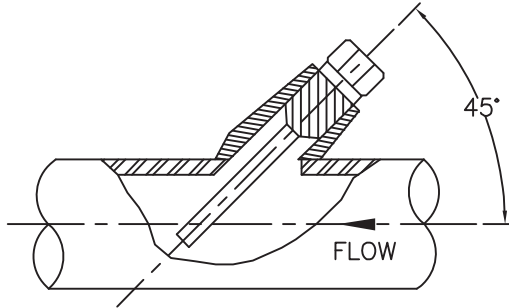


INSTALLATION TYPE-1

FOR MAIN PIPE OD 88.9mm to 159mm

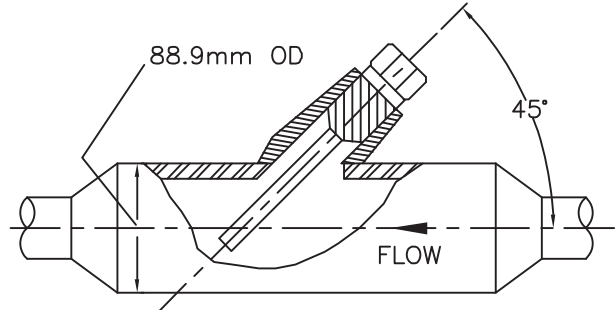


INSTALLATION TYPE-2

FOR MAIN PIPE OD BELOW 88.9mm

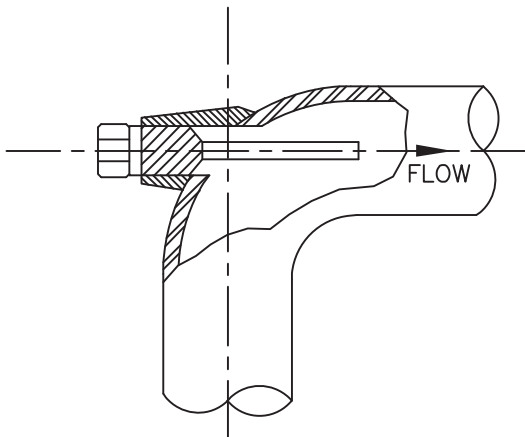

INSTALLATION TYPE-3

FOR MAIN PIPE OD 88.9mm & BELOW

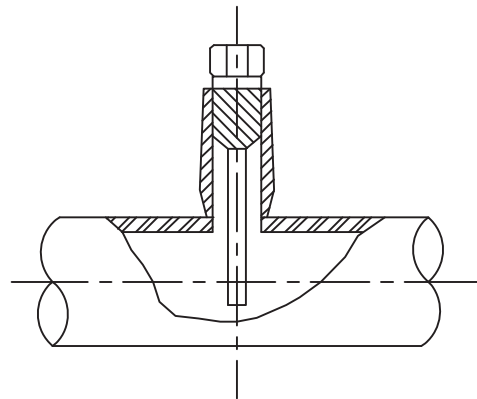

INSTALLATION TYPE-4

FOR MAIN PIPE OD 168.3mm & ABOVE



TITLE : 5 x 800 MW YADADRI TPS

STD INSTRUMENT STUB
DETAILS

THERMOWELL INSTALLATION

DRG. NO.
PE-DG-417-145-I101
REV. 00
SH. 06 OF 06



**5x800MW YADADRI TPS
AIR CONDITIONING SYSTEM
STANDARD TECHNICAL SPECIFICATIONS**

SPECIFICATION No: PE-TS-417-553-A001

SECTION : I

SUB-SECTION : D

REV. 00

SECTION: I

SUB-SECTION: D

STANDARD TECHNICAL SPECIFICATIONS



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

REV. 02

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING PLANT**



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

SHEET 2 OF 6

1. GENERAL

1.1 This specification covers the design, manufacture, testing at Manufacturer's works, delivery to site, handling at site, installation, commissioning and carrying out acceptance tests and final painting at site of various equipment of the central air conditioning plant, as specified hereinafter.

2. CODES & STANDARDS

2.1 The design, manufacture and performance of air conditioning equipment shall comply with all currently applicable statutes, regulations and safety codes in the locality where the equipment are to be installed. The equipment shall also conform to the latest applicable Indian/British/American standards. Nothing in this specification shall be construed to relieve the tenderer of this responsibility. In particular the equipment shall conform to the latest editions of the following standards.

- 2.1.1 IS-660 : Safety code for Mechanical Refrigeration.
- 2.1.2 ARI 520-90 : Standard for Positive Displacement Refrigerant compressors and condensing units.
- 2.1.3 IS-5111 : Code of Practice of Measurement for Testing Refrigeration compressors.
- 2.1.4 ASHRAE/23-93 : Method of Testing for Rating Positive Displacement Refrigerant compressors and condensing units.
- 2.1.5 ARI-450: Standard for water-cooled Refrigerant condensers, Remote Type.
- 2.1.6 ASME : Unfired pressure Vessels Code.
(Section VIII)
- 2.1.7 IS-2825 : -do-
- 2.1.8 IS-4503 : Shell and tube type heat exchangers.
- 2.1.9 ASHRAE/22-92 : Method of Testing for rating of Water Cooled refrigerant condensers.
- 2.1.10 IS-659 : Safety code for Air conditioning.
- 2.1.11 IS-2379 : Color Code for Identification of pipe lines.
- 2.1.12 TEMA : Standards of Tubular Exchanger manufacturers Association.
- 2.1.13 IS-1239 (Part-I) : Seamless steel tubes (Up to & including 168.2 mm OD.).
- 2.1.14 IS-3589 : For piping above 168.2mm to 2032mm Outside Diameter.
- 2.1.15 IS-778 : Valves up to 50 MM.
- 2.1.16 IS-780 : Valves 50 MM to 300 MM.
- 2.1.17 ASHRAE 24 : Method of Testing for Rating liquid coolers.



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

SHEET 3 OF 6

2.1.18 ARI-480: Standard for refrigerant cooled liquid coolers-Remote type.

3. DESIGN & CONSTRUCTION REQUIREMENTS

3.1 The components of Central air conditioning plant comprising compressor, chiller refrigerant piping, valves and fittings etc. Shall be as given in Data sheet A. The type of all accessories, controls and instrumentation shall also be as indicated in data sheet A.

3.2 The various equipments supplied under this specification shall be fully compatible with each other & capable of operating as fully balanced integrated system to deliver the specified output under design conditions.

4. TESTING AND INSPECTION

(Refer standard quality plan)

4.1 Hydrostatic, Volumetric and refrigerant leak tests etc. shall be carried out at manufacturers works before dispatch of equipment in accordance with the applicable codes and standards.

Following minimum tests amongst others shall be conducted.

4.1.1 Material analysis, testing and identification (Data sheet/ Drg. Shall clearly indicate the specification, grade, class and Heat treatment condition of material for which TC will be furnished)


4.1.2 Hydrostatic pressure test of all pressure parts.(Testing pressure shall be clearly indicated for each component/ subassembly/ assembly)

4.1.3 Static and Dynamic balancing test of rotating parts at rated and over speed and to determine vibration & noise level.(Grade of balancing, type- whether dynamic or single plane balancing for components/ subassembly/ assembly shall be clearly indicated in data sheet/ approved drg.. Permissible vibration (velocity and displacement –peak to peak and noise level in dB(A) to be indicated in Data Sheet/Approved Drg.)

4.1.4 Radiography & magna-flux examination of materials & welds.(Components to be subjected to NDT with applicable, procedures and acceptance norms to be clearly indicated in Data sheet/ approved drg. If in a component only certain areas are to be subjected to NDT same shall be clearly brought out else it will be understood that the entire component is subject to NDT)

4.1.5 Ultrasonic test of castings & forgings.(Procedure and acceptance norms with areas subject to NDT to be clearly indicated in Quality Plan).

4.1.6 Performance test including determination of capacity, efficiency & characteristics etc.(Applicable standard, Acceptance norms, Procedure for test (if not covered in applicable standard),performance characteristics with applicable tolerances and drive to be used during shop test to be clearly indicated in Quality Plan). Performance data to be indicated in Approved Drg./ Data Sheet)

	STANDARD TECHNICAL SPECIFICATION FOR CENTRAL AIR-CONDITIONING	SPECIFICATION NO.PES-553-01
		VOLUME II B
		SECTION D
		SHEET 4 OF 6
4.1.7	Functional checks and adjustments of controls & instrumentation. (Functional checks required to be clearly indicated with extent of check and applicable standard in approved check list / Quality plan. Class of instruments / tolerances and performance data to be incorporated in Approved Data Sheet / Drg.)	
4.1.8	Checking of working clearances.(desired working clearances to be indicated in approved Drg.)	
4.1.9	Examination after selective opening up after testing.(basis/ reasons for selective opening up, areas to be examined and parameters to be checked to be brought out in Quality Plan)	
4.2	TESTS AT SITE	
	Tests to prove guaranteed performance of the air conditioning plant, shall also be carried out at site after proper installation. The site test shall include performance testing (as per FQP) of equipment for 72 continuous hours each in all three seasons i.e. Summer, Winter and Monsoon. Unless specified elsewhere. All instruments, tools etc. as may be required to carry out site tests shall be arranged by the tenderer.	
5.	<u>PERFORMANCE GUARANTEE</u>	
5.1	Each equipment of air conditioning system shall be guaranteed for its rated capacity under the specified site conditions.	
5.2	If the shop/site performance tests indicate failure of equipment to meet specified requirement, it would be tenderer's responsibility to carry out required alterations at no extra cost to purchaser. Tests shall be repeated after carrying out the modifications to demonstrate the performance.	
5.3	The air conditioning plant before being taken over by purchaser shall be subjected to running test for a minimum period of one week during which all readings shall be recorded. Any deficiencies noted during this period, shall be rectified by the tenderer /at no extra cost to purchaser. These running tests shall be in addition to the seasonal performance test specified under clause 4.2. The inside design conditions shall be guaranteed throughout the year.	



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

SHEET 5 OF 6

6. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

6.1

6.2 Drawings including equipment layout, foundation & loading details etc. for civil works for the entire plant. These drawings must cover sufficient details so that design of civil works can be completed.

6.3 Inspection, operation & Maintenance Manuals.

6.4 Manuals for method of testing & calibration of all instruments.

6.5 Equipment description giving complete design calculations, basis of design, selection criteria etc.

6.6 Schematic piping diagrams.

6.7 Layout of piping.

6.8 Electrical drawings.

6.9 Test Certificates.

6.10 Final as built documentation i.e. final-version of all drawings, data & information as per the requirement specified elsewhere.



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

SHEET 6 OF 6



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 4

DESCRIPTION

DATA

1. GENERAL

- 1.1 Type of AC plant : Chilled Water Type.
- 1.2 Plant configuration/capacity. : Refer to Section-C of Specific Technical Requirements.
- 1.3 Location of AC plant rooms : As per Tender drawings.
- 1.4
- 1.5 Electrical work scope: -
i) MCC for AC plant : By Others
ii) Power cables / Control cables. : By Others
iii) Drives : By Bidder.
iv) Whether separate alarm/annunciation Panel/control panels required : Yes (By bidder), Refer to Section-C of Specific Technical Requirements.
v) Termination of cabling & earthing at Equipment end. : By Bidder for bidder supplied equipment.

2. REFRIGERATION COMPRESSOR

- 2.1. Type : SCREW CHILLE
- 2.2. Nos. (working + standby) : Refer to Section-C of Specific Technical Requirements.
- 2.3. Type of capacity control : Automatic.
- 2.4. Type of drive : Direct driven.
- 2.5. Restart after tripping : Manual.
- 2.6. Type of start : As per manufacturing standard.
- 2.7. Shaft Seal : Mechanical shaft seal.
- 2.8. Purge Recovery unit : As per manufacturing standard.
- 2.9. Type of lubrication : As per manufacturing standard.
- 2.10. Refrigerant used : Environment friendly HCFC, (CFC is not acceptable)



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 2 OF 4

3. DESIGN REQUIREMENTS

- 3.1. Minimum capacity at Design conditions : Refer to Section-C of Specific Technical Requirements.
- 3.2. Capacity control : Microprocessor based Control Panel sheet metal panel, located on each Compressor/chiller unit including protection devices
- 3.3. Vibration isolator : Neoprene rubber pads/Equivalent approved to suit chiller package.
- 3.4. Type of foundation : Floating / As per manufacturing standard

4.0 CONDENSER

- 4.1 Type : Horizontal shell & tube type water-cooled
- 4.2 Number required : One no. for each machine.
- 4.3 Design requirements
- 4.3.1 Fluid : Refrigerant (Shell side) Water (tube side)
- 4.3.2 Cooling Water Quantity : To suit requirement.
- 4.3.3 Capacity of condensers : To match compressor & to provide at least 2°C sub cooling.
- 4.3.4 Cooling water inlet temp. : Refer to Section-C of Specific Technical Requirements.
- 4.3.5 Leaving Water Differential. : Refer to Section-C of Specific Technical Requirements.
- 4.3.6 Max. flow velocity through tubes. : 2.5 m/sec.
- 4.3.7 Design fouling factor : 0.0002 (MKS Unit)
- 4.3.8 Maximum pressure drop. : 0.6 Kg/cm² (g)
- 4.3.9 Tube wall Thickness : Not less than 18 SWG
- 4.4 Materials of construction
- i/ Shell : M.S. Plate fusion welded.
- ii/ Tube : Integrally bonded Seamless copper



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 3 OF 4

- iii/ Head ends : Cast Iron.
- iv/ Tube sheet material : Steel
- v/ Baffle plate : Steel.
- 4.5 Accessories required
- i/ Purge & drain connections with valves. : Yes
- ii/ Relief valves : Yes
- iii/ Liquid line shut off valve. : Yes
- iv/ Isolating valves on water side. : Yes
- v/ Flow switch : Yes (interlocked with control of individual refrigeration system)
- vi/ Pressure/temperature gauges at inlet/outlet : Yes
- vii/ Descaling tee : Yes
- viii/Charging valve : Yes
- ix/ MS supporting frame work : Yes
- viii/Cooling thermostat : Yes
- ix/ MS supporting frame work. : Yes
- 5.0 **CHILLER** (Applicable for chilled water type plant only.)
- 5.1 Type : Horizontal shell & tube flooded type
- 5.2 Number required/standby : One no. for each chiller package.
- 5.3 Design requirements
- 5.3.1 Fluid to be cooled : Water
- 5.3.2 Water flow rate (Inside tube) : To suit requirement.
- 5.3.3 Water inlet temperature : 12 °C approx.
- 5.3.4 Water outlet temperature : 7 °C approx.
- 5.3.5 Super heating of refrigerant material : By at least 3 deg. C.
- 5.3.6 Insulation /thickness/finish : As per the manufacture standard.
- 5.3.7 Design fouling factor : 0.00010(MKS Unit)



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 4 OF 4

- 5.3.8 Maximum pressure drop. : 0.6 Kg/cm² (g)
- 5.3.9 Tube wall Thickness : Not less than 22 SWG.
- 5.4 Materials of construction
- i/ Shell : M.S. Plate fusion welded.
- ii/ Tube : Integrally Seamless copper (internally Corrugated)
- iii/ Head ends : Cast Iron.
- iv/ Tube sheet material : Steel.
- v/ Baffle plate : Steel.
- 5.5 Accessories required
- i/ Purge & drain : Yes
- ii/ Gate valves at water inlet/outlet. : Yes
- iii/ Flow switch : Yes
- iv/ Pressure/temperature gauges at inlet/outlet : Yes
- v/ Anti-freeze thermostat : Yes
- vi/ Thermostatic expansion valves : Yes
- vii/ Pilot solenoid valve : Yes
- viii/ Cooling thermostat : Yes
- ix/ MS supporting frame work. : Yes

Note :-

The system shall also incorporate:

- 1) Auto operation of chilling plant for operation of the whole AC system.
- 2) A Central Control Panel with fault annunciators with provision for remote extension besides local control kiosks.
- 3) Water Chiller package shall be skid-mounted unit with microprocessor based control panel complete with all accessories and controls are assembled at manufacturing works on single unit.
- 4) Screw chiller shall be suitable for 415V \pm 10 %/50 Hz \pm 3%/3 phase operation with voltage & frequency variation as specified with built in starter etc.
- 5) Only supply feeders shall be provided for chillers.



TECHNICAL SPECIFICATION

AIR HANDLING UNITS


SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
AIR HANDLING UNITS**

	TECHNICAL SPECIFICATION AIR HANDLING UNITS	SPECIFICATION NO.PES-553-02
		VOLUME II B
		SECTION D
		SHEET 2 OF 6

1. GENERAL

1.1 This specification covers the design, manufacture, Construction features, installation, commissioning, inspection and performance testing at site of AHUs.

2. CODES AND STANDARDS

2.1 The design manufacture and performance of AHU shall comply with all currently applicable statutes, regulations and safety codes in the locality where the AHU is to be installed. The equipments shall also conform to the requirements of the latest editions of applicable Indian/British/US standards. Nothing in this spec. shall be construed to relieve vendor of this responsibility. In particular the equipment shall conform to the latest editions of the following standards:

2.1.1 IS-659 : Safety code for air conditioning

2.1.2 IS-660 : Safety code for mechanical refrigeration

2.1.3 ASHRAE: Method of testing forced circulation air-cooling and air heating coils.
standard 33

2.1.4 ARI 41 : Standard for forced circulation air cooling and air heating coils.

2.1.5 ARI 430/435 : Air-cooling and air heating coils Central Station AHU / Application
of Central Station AHU.

2.1.6 AMCA : 211 and 311


In case of any conflict in the standards and this specification the decision of PEM,BHEL shall be final and binding.

3. CONSTRUCTION FEATURES

3.1 The casing of AHU shall be made of insulated double wall construction of min. 24 gauge galvanized sheet steel - IS 277 Gr. 120 (parent sheet: D/DD-IS-513) ribbed and reinforced for structural strength and rigidity with 25 mm thick polyurethane insulation of minimum 40 kg/m³ density in between. The external wall will be pre-plasticised over GI coating on the outside. Angle irons or channel sections made of 16 gauge galvanized sheet steel shall be used for reinforcing. The casing shall be of sectionalized construction with proper sealing at the joints to make them air tight. Fan section and panels with bearing support shall be reinforced with heavy gauge channels (min. 5 mm thick). Suitable number of forged hot dip galvanized (610 gm/sq.m) U brackets shall be provided for AHU suspended from ceiling/roof.

Necessary arrangement shall be provided on the casing for measuring temperature and pressure in cooling/heating coil. Class of instruments shall be min. 2.

3.2 Fan impeller shall be forwardly/backwardly inclined curved blade centrifugal type. Impeller shall be double width double inlet type. Fans shall be preferably low rpm (<=1500) to minimize vibration and noise. Noise shall be within 85 dB(A) at 1 metre distance from AHU casing. Max. Vibration level shall be acceptance and norms to be specified. Two to three wheels (impellers) shall be provided for each AHU. Impeller blades shall be fabricated from (min. 1.0 mm) galvanized/ epoxy powder coated sheet steel. Fan shall be of epoxy powder coated / galvanized sheet steel (min. 1.6

	TECHNICAL SPECIFICATION AIR HANDLING UNITS	SPECIFICATION NO.PES-553-02
		VOLUME II B
		SECTION D
		SHEET 3 OF 6

mm) scroll with die formed inlets for uniform air flow. Fan shafts shall be solid cold rolled carbon steel (EN8 normalised), ground and polished. Fan shaft bearings shall be of heavy duty type selected for average operating life of 100,00 hours. Bearings shall be self-aligning, permanently lubricated type. Make of Brgs(SKF/FAG/NORMA/TATA) to be specified. Bearing Housing shall be of casting of min. IS Gr. 210, split type and suitably supported. The V-belt drive with belt guard shall be provided. Motors shall have minimum 15% margin over maximum BHP in working range.

3.3 DX or chilled water cooling coils and steam/hot water coils shall be internally corrugated copper/ cupronickel tubes (as per manufacturer's standard) with smooth non corrugated external fins of aluminium (thickness 0.14 mm and grade 1100 as per spec) unless specified otherwise in specification. At least 5 fins /per cm. shall be provided. The chilled water/hot water coils shall have suitable (standardize class, size, threading) drain and vent connections.

3.4 The filters in the filter section shall be provided as detailed in data sheet A.

3.5 Humidifier shall be Pan type/as specified in the specification.

Pan type Humidifier consisting of SS304/316 tank, heater, geysersstat with piping connection to supply air duct shall be provided unless specified otherwise in data sheet A.

Heaters and branch line shall be of galvanized steel and nozzles shall be of brass (matl. grade) /SS 304.

3.6 Condenser water from coil or surplus water from spray humidifier shall be collected in 16 gauge SS-304 pan. Minimum 50mm dia GI pipe nipple shall be provided on each end for drain connection. The drains for these points shall be extended to the main drain in AHU room. Condensate drain pipe (GI) of required length with sealing loop shall be provided and insulated as specified in the specification for insulation. Minimum requirement For GI Pipes and fittings shall be ERW/Seamless of medium thickness as per IS-1239/3589 and Hot dip galvanized

3.7 Suitable number of Spring type vibration isolators shall be provided for fan and motor assembly. Neoprene rubber pads shall be provided below the AHU.

The AHU shall be provided with 18 G SS drain pan.



TECHNICAL SPECIFICATION

AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B


SECTION D

SHEET 4 OF 6

4.

TESTING AND INSPECTION AT MANUFACTURERS WORKS:

List of TCs arranged as per Approved Quality Plan shall be furnished along with copy of TCs at the time of inspection.

	TECHNICAL SPECIFICATION AIR HANDLING UNITS	SPECIFICATION NO.PES-553-02
		VOLUME II B
		SECTION D
		SHEET 5 OF 6
4.1	Visual inspection of GI sheets and angles, channels etc. – dents, black spots, chipping of zinc coating, white dust on galvanised sheets shall be avoided. Pitting , lamination in angles and channels shall be avoided.	
4.2	Galvanised sheets - Test certificate shall be furnished for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating. For pipes and fittings compliance report shall be furnished by Manufacturer for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating.	
4.3	Shaft: Mechanical and chemical.	
4.4	Motors (of approved make): Routine TC.	
4.5	Workmanship and dimensional check as per manufacturing drg. and approved Drgs.	
4.6	Balancing of impellers- Dynamic balancing certificates shall be furnished –grade 6.3 or better to ISO-1940. Balancing weights shall be positively locked to avoid loosening. Balancing weights and fasteners used shall be galvanized.	
4.7	Performance test of one Centrifugal fan/per type/per size as per AMCA standard (for indigenous make).	
4.8	Centrifugal fans for AHUs will be 100% run tested by main contractor of BHEL. One centrifugal fan/per type/per size will be run tested. Vibration shall be within good zone of VDI 2056 / ISO 10816-1(group- K) machines when measured on bearing housing and noise level <85 dbA at 1 metre distance. Max. Temp. on bearing housing- 40 degrees Centigrade + ambient.	
4.9	Complete assembly of one AHU/per type/ per size (excluding cooling coil and filter) shall be witnessed.	
4.10	Run test of one complete assembly/per type/per size (excluding cooling coil and filter). Vibration shall be within satisfactory zone of VDI 2056 / ISO 10816-1(group- K) machines when measured on bearing housing and noise level <85 dbA at 1 metre distance. Max. Temp. on bearing housing- 40 degrees Centigrade + ambient.	



TECHNICAL SPECIFICATION

AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

SHEET 6 OF 6

5. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

5.1

5.2 Drawing including equipment layout, foundation & loading details etc. for civil works. These drawings must cover sufficient details so that design of civil works can be completed.

5.3 Inspection, operation & Maintenance Manuals.

5.4 Equipment description giving complete design calculations, basis of design, selection criteria etc.

5.5 Test Certificates.

5.6 Final as built documentation i.e. final-version of all drawings, data & information as per the requirement specified elsewhere.

5.7 Performance Test Certificates.



AIR HANDLING UNIT
DATA SHEET - A

VOLUME - II-B

SECTION - D

SHEET 1 OF 2

DESCRIPTION

DATA

- | | |
|--|--|
| 1. Nos. required/working | : Refer to Section-C of Specific technical requirement. |
| 2. Location | : Refer to Section-C of Specific technical requirement. |
| 3. Service/type | : Air Conditioning /Double skin. |
| 4. Fan type | : Centrifugal (forward/backward curve Blade) limit load. |
| a) Capacity | : To Suit as per calculation. |
| b) Static pressure | : To suit but not less than 60 mm wc for AHU's Micro-V filters. |
| c) Discharge direction | : To suit layout. |
| d) Motor | : By Bidder, |
| e) Local push button station (Start/Stop) | : By Others |
| f) Motor location | : Inside AHU Casing. |
| g) Drive | : Belt, pulley, belt guard. |
| 5. Face and Bypass Damper | : Required (Opposed blade type) DX AHU's having |
| 6. Cooling coil | |
| a) Duty sensible heat | : To suit as per calculations |
| b) Duty latent heat | : -do- |
| c) Type of coil | : Chilled Water/DX/Hot Water. |
| d) No. of rows | : To suit but not less than four (4) |
| e) Material of tube /Thickness | : Seamless Copper to ASTM E-75/Equivalent. |
| f) Material of fins | : Aluminium to SAE-1100-/1145-0 |
| g) Number of fins | : Not greater than 5 per cm (13 per inch). |
| h) Max. face velocity | : 2.5 m/sec. |
| i) Air flow quantity | : To suit as per tender drawings/documents. |
| 7. 3 - way motorised mixing valve with thermostat. | : Required with thermostat & actuator for chilled water system for each AHU. |



AIR HANDLING UNIT
DATA SHEET - A

VOLUME - II-B

SECTION - D

SHEET 2 OF 2

- | | | |
|-----|------------------------------|--|
| 8. | Damper at discharge | : Manually operated at discharge of each AHU outlet. |
| | a) Material of construction | : Mild Steel, galvanised. |
| 9. | Filters (Pre-filters) | |
| | a) Type & thickness | : Dry panel type/ 50 mm |
| | b) Filter area. | : To suit as per velocity requirements. "V" - Bank. |
| | c) Filter efficiency | : Average arrestance efficiency of 65-80 % |
| | d) Press drop (Clean) | : Not to exceed 2.5 mmwc when clean & 6.5 mmwc while dirty. |
| 10. | Humidification section | : As per the System requirement. |
| | a) Type | : Pan type, unless otherwise specified. |
| | b) Operation | : Automatic with Humidification. |
| 11. | Fresh air arrangement | : Required. |
| | a) Fresh air fan | : Tube axial flow fans with motor. |
| | b) Accessories | : i) Inlet cone with Bird screen.
: ii) Dry panel pre-filters,
: iii) High efficiency filters for control room areas.
: iv) Volume Control Dampers,
: v) Supports etc. |
| 12. | Vibration isolator required. | : Yes |
| 13. | Type of vibration isolator. | : Neoprene ribbed Rubber for AHU's. |
| 14. | Any other requirement | : i) In addition to dry panel filters on AHU, High efficiency filters(average arrestance efficiency of 80-90 %) shall be provided in supply air duct side of AHU for all control room and allied areas.

: ii) Bidder to also provide suitable electrical strip heaters for winter heating & monsoon reheating with Contactor box etc. Heaters to be interlocked with airstat. |
| 15. | Instrument & controls | : Lot.(including Control box for strip heaters, pan humidifiers etc. in each AHU room.) |
| 16. | Insulation of drain piping | : Lot. |



**STANDARD TECHNICAL
SPECIFICATION
FOR
COOLING TOWER**


SPECIFICATION NO.PES-553-03

VOLUME II B

SECTION D

SHEET 1 OF 5

**STANDARD TECHNICAL SPECIFICATION
FOR
COOLING TOWER**

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03
		VOLUME II B
		SECTION D
		SHEET 2 OF 5

1. GENERAL

1.1 this standard specification covers the design, manufacture assembly, inspection & testing at manufacturer's works, suitable painting & packing, delivery, erection & commissioning at site of all materials and equipments for mechanical induced draught cooling tower complete with all accessories as specified hereinafter.

2. CODES & STANDARDS

2.1 the design, manufacture, inspection & testing and performance of the cooling tower as specified hereinafter shall comply with the requirements of all applicable latest Indian/British/American standards and codes of practice. the latest editions of the following standards & publications shall be followed in particular:

2.1.1 Cooling tower institute USA bulletin ATP-10S: Acceptance test procedure for industrial water-cooling tower.

2.1.2 PTC-23 ASME performance test code for Atmospheric water-cooling equipment.

2.1.3 In case of any conflict between the above codes & standards and-this specification, the later shall prevail.

3. DESIGN REQUIREMENTS

3.1 the cooling tower shall be designed for continuous operation to cool not less than design flow of water from specified inlet temperature to the outlet temperature at a design ambient wet bulb temperature as indicated under data sheet a.


3.2 all the components shall be capable of safe, proper and continuous operation at all cooling water flows upto & including those specified under data sheet a & shall be designed with regard to case of maintenance, repair, cleaning & inspection.


3.3 the cooling tower shall be of induced draught cross flow or counter flow type and with multiple cells (if specified in data sheet a.) the cooling tower shall be suitable for handling the fluid and also for achieving the specified parameter as per data sheet a. the cooling tower shall be designed such that the drift losses & evaporation losses are minimum.

4. CONSTRUCTIONAL FEATURES

4.1 CASING & LOUVERS

4.1.1 The cooling tower casing shall be made of FRP/as specified in data sheet A. The louvers shall be made of FRP/as specified. Louvers, if provided, shall be designed for air entry to the tower with low velocity for minimum pressure drop & less chance of recirculation of moist air. To eliminate splash out, louvers shall slope to shed water inwards. Air intake shall be all along the base circumference of the casing & hotdip galvanised expanded metal mesh shall be provided to protect the air intake.

	TECHNICAL SPECIFICATION	SPECIFICATION NO.PES-553-03
		VOLUME II B
	COOLING TOWER	SECTION D
		SHEET 3 OF 5
4.2	FILL	
4.2.1	<p>Cooling tower fills shall be made of noncombustible PVC/as specified in data sheet A. The design & arrangement of the fills shall be so as to expose maximum air/water surface with minimum pressure drop.</p>	
4.3	Drift Eliminators	
4.3.1	<p>Multi-pass drift eliminators with minimum two pass zig-zag path shall be provided so to minimise the drift losses.</p>	
4.3.2	<p>In case of FRP cooling tower the drift eliminators shall be of multi-blade rotary type.</p>	
4.4	Fans & Accessories	
4.4.1	<p>The fans shall be multiple blade, low speed, high efficiency axial flow type located above the top deck level of the cooling tower. Fan rotating assembly shall be statically & dynamically balanced. The fan blades shall be preferably adjustable in stand still condition for propeller action. The fan shall be either directly mounted on the shaft of a totally enclosed weather proof motor or shall be suitable for V-belt drive.</p>	
4.4.2	<p>The rating of drive motor shall have at least 15% margin over maximum fan power consumption. The design & construction of the drive motor shall be in accordance with enclosed specification for LVAC motors.</p>	
4.5	Water basin	
4.5.1	<p>The material of construction of water basin shall be FRP or RCC as specified in data sheet A. The basin shall be provided as a part of cooling tower in case of FRP construction. The sump shall have sufficient storage capacity for safe operation of AC plant.</p>	
4.6	Hot water distribution system	
4.6.1	<p>Manually operated flow control valves shall be provided in hot water distribution piping such that each cooling tower can be isolated without affecting the operation of other cells.</p>	
4.6.2	<p>The nozzles shall be spaced to give even distribution of water over entire space occupied by top row of fills. The nozzles shall be made of brass /SS 304/316/316L (brass shall be as per manufacturer's standard) unless specified in data sheet A:</p>	
4.6.3	<p>In case of FRP tower water shall be distributed over the fill by means of a multiple area fail safe rotary sprinkler made of PVC pipes fitted on a aluminium alloy (as per manufacturers standard) rotary head and mounted on sealed ball bearings (make) .</p>	
4.7	Access	
4.7.1	<p>A stair case paddle ladder (as per manufacturer's standard) shall be provided external to the cooling tower at one end of each tower along with stairways hand rails etc give safe & convenient access to the top deck from ground level.</p>	

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03
		VOLUME II B
		SECTION D
		SHEET 4 OF 5

- 4.8 Painting
- 4.8.1 The cooling towers shall be painted with suitable anti-corrosive paint as per approval of purchaser. All galvanized external surfaces shall be painted to match colouring scheme. Before painting galvanized surfaces -etch primer to be applied.

5. SHOP INSPECTION & TESTING


- 5.1 Compliance certificates for nozzles (Or rotary sprinkler), piping, fill material, drift eliminator, louvers components etc.
- 5.2 Certificate of conformance for all other material components.
- 5.3 Balancing report for Static & dynamic balancing of fan assembly.

6. TESTS AT SITE

- 6.1 Hydrostatic testing of complete hot water distribution piping at site.

7. PERFORMANCE GUARANTEE

- 7.1 The cooling tower shall be guaranteed to meet the performance requirements as specified & when tested in accordance with ATP-105.
- 7.2 The vendor shall furnish performance curves for the cooling tower showing variations in performance from design duty point with change in approach to wet bulb temperature, cooling range, water loading of cooling tower.

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03
		VOLUME II B
		SECTION D
		SHEET 5 OF 5

- 8. DATA TO BE FURNISHED BY VENDOR AFTER THE AWARD OF CONTRACT**
- 8.1 General arrangement drawing of complete cooling tower (showing plan, front elevation and side elevation) incorporating principal dimensions, limits of scope of supply of piping, limits of civil works included showing extent of platforms, walkways, handrails, access doors, staircase etc. and the limits of scope of supply of electrical works.
- 8.2 General arrangement and sectional assembly drawings pertaining to the following components of the cooling tower:
- i) Tower fill with supporting arrangement.
 - ii) Drift eliminator installation and details.
 - iii) Complete hot water distribution system including flow regulating valves, distribution basin/pipes and nozzles etc.
- 8.3 Cooling tower performance curves showing WBT Vs cold-water temperature for design cooling range, 90% cooling range and 110% cooling range at 100%, 90%, and 110% design flow.
- 8.4 Performance curves of cooling tower fans.
- 8.5 Test procedure along with details of tests to be conducted for the offered cooling tower.
- 8.6 Quality Plan along with complete details of the testing and inspection requirements of mechanical and electrical items of the cooling tower in BHEL format.
- 8.7 Operation and maintenance instructions.



**COOLING TOWER
DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 2

A. GENERAL DATA

- 1) Service : Cooling of condenser water of AC plant.
- 2) Type : Fibreglass reinforced plastic construction induced draught.
- 3) Quantity : Refer to Section-C of Specific Technical Requirements.
- 4) Place of installation : Refer to Section-C of Specific Technical Requirements.

B. DESIGN DATA

- 1) Capacity at specified conditions. : To suit the system requirement.
- 2) Water flow rate : To suit the system requirement.
- 3) Design wet bulb temperature : 25 Deg. C.
- 4) Hot water inlet temperature : To suit requirement.
- 5) Cooled water temperature : To suit requirement.
- 6) Depth of sump Tank : As per manufacturer's standard.

C. MATERIAL

- 1) Sump tank & Casing : FRP
- 2) Louvers : FRP/PVC/Aluminium.
- 3) Type of fill : Non-combustible PVC/Eq.
- 4) Nozzles : Brass with chrome plating/polypropylene.
- 5) Ladder : Hot dip galvanized steel ladder for each tower.
- 6) Bird screen : 25 mm square made of GI/SS wire mesh of 16 gauge.
- 7) Fan impeller : Cast Aluminium Alloy/FRP propeller type and multi-blade aerofoil construction with adjustable pitch..
- 8) Supporting structure : MS with spray galvanization of epoxy painting.
- 9) Strainer : Plant strainer made of GI/SS wire mesh of 16 gauge.

D. ACCESSORIES

- 1) Make up connection : Yes.



**COOLING TOWER
DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

SHEET 2 OF 2

- 2) Quick fill connection : Yes.
- 3) Overflow & drain & blow down connection : Yes.
- 4) Access door in louvers/fan deck : Yes (if applicable).
- 5) Supports & supporting structure for mounting : Yes.
- 6) Level switch : Yes.
- 7) Rain protection for motor : Yes (suitable Canopy by Bidder)
- E. ELECTRICAL DATA
- i) Power supply : 415 V \pm 10%/50 Hz \pm 3%/3 phase.
- ii) Motor : As per specification attached.
- F. INSPECTION & TESTING : As per approved quality plan.



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 1 OF 9

STANDARD TECHNICAL SPECIFICATION
FOR
LOW PRESSURE AIR DISTRIBUTION SYSTEM



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 2 OF 9

1. GENERAL

1.1 This specification covers the design, manufacture, construction features, installation, inspection testing and air balancing of air distribution system upto a total pressure of 95mm w.g. The specification is intended to cover the air distribution for air conditioning system and ventilation system not involving localised exhaust.

2. CODES AND STANDARDS

2.1 The design, construction and performance of complete system shall conform to all currently applicable statutes, regulations, safety codes in the locality where the equipment are to installed

2.2 Unless specified otherwise the equipments shall generally conform to latest applicable Indian Standards. Nothing in this specification shall be construed to relieve the vendor of this responsibility. In particular the equipment shall generally conform to latest editions by the following standards:-

- a) IS: 655 - Specifications for metal air ducts.
- b) IS:277 - Specifications for galvanised steel sheets.
- c) IS:737 - Specification for wrought aluminium and aluminium alloy sheet and strip.

3. MATERIAL

3.1 Metal air ducts shall be either of galvanised steel sheets or aluminium sheets, as indicated in data sheet-A.

3.2 The rolled steel sheets before galvanising shall be properly annealed or normalised so as to allow fabrication of ducts without developing cracks. Zinc coating on the steel shall be as per technical requirement refer to Section-C of Specific Technical Requirements.

3.3 The aluminium sheets shall be of grade S1C or NS3 and shall be suitable for duct fabrication work as per IS-737 latest

4. CONSTRUCTION/FABRICATION

4.1 The thickness of sheets, the type of bracing and other fabrication details shall generally conform to requirements given hereunder unless specified otherwise in data sheet A and/or indicated on drawings.

4.2 RECTANGULAR DUCTS

4.2.1

S.No.	Max Side	Sheet Thickness	Type of transverse	Bracings
-------	----------	-----------------	--------------------	----------



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 3 OF 9

		(mm) GI	(mm) AI	Joint connections	
a)	Up to 600	0.63 (24G)	0.80	S-drive, pocket or bar slips or flanged joints on 2.5m centres	None
b)	601 to 750	0.63 (24G)	0.80	S-drive, 25mm pocket or 25mm bar slips or flanged joints on 2.5m centres	25x25x3 mm MS angles, 1.2m from joints
c)	751 to 1000	0.80 (22G)	1.00	S-drive, 25mm pocket or 25mm bar slips or flanged joints on 2.5m centres	25x25x3 mm MS angles, 1.2m from joints
d)	1001 to 1500	0.80 (22G)	1.00	40x40x3mm MS angle, flanged connections or 40mm pocket or 40mm bar slips with 35x3mm bar reinforcing on 2.5m centres	40x40x3 mm MS angles, 1.2m from joints
e)	1501 to 2250	1.00 (20G)	1.50	40x40x3mm MS angle, flanged connections or 40mm pocket or 40mm bar slips, 1M maximum centres, with 35x3mm bar reinforcing	40x40x3 mm diagonal angles or 40x40x3mm angles, 600mm from joints
f)	2251 & above	1.25 (18G)	1.80	50x50x3mm MS angles, connections or 40mm pocket or 40 mm bar slips, 1M maximum centres with 35x3mm bar reinforcing.	50x50x3mm diagonal angles or 50x50x3mm angles 600 mm from joints.
g)	No bracing is required if transverse joints are less than 600mm apart				
h)	For ducts larger than 2250mm, special handling and supporting methods shall be provided as per the approval of Purchaser				

4.2.2 All rectangular ducts having either dimension larger than 450mm shall be cross broken except these ducts which are insulated with sand cement plaster. Air outlet connections on ducts need not be cross broken.

4.2.3 The seams on duct cones shall be of Pittsburgh type. Longitudinal seams shall be smooth inside the ducts.

4.2.4 The flanges used for transverse joints shall be joined together with GI bolts (grade 4.6) and nuts spaced at 125mm centres as per following:

- a) Upto 1000mm - 6 mm dia GI bolts
- b) 1001 to 1500 - 8 mm dia GI bolts
- c) 1501 and above - 10mm dia GI bolts



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 4 OF 9

4.2.5 The MS angle flanges shall be connected to ducts with rivets at approx. 100mm centres. The flanged joints shall have 6mm thick felt packing stuck to flanges with shellac varnish. The holes in the felt packing shall be burnt through. The ducts are to be tapped 6mm across the MS flanges.

4.2.6 MS angles used for bracings shall be tack welded to the ducts or rivetted at 125mm centres, as applicable.

4.3 ROUND DUCTS

4.3.1

S.No.	Duct dia-mm	Sheet Thickness		Reinforcing
		(mm) GI	(mm) Al	
a)	Up to 150	0.63 (24G)	0.80	None
b)	151 to 600	0.80 (22G)	1.00	None
c)	601 to 1000	1.00 (20G)	1.50	40x40x3mm girth MS
d)	1001 to 1250	1.00 (20G)	1.50	40x40x3mm girth MS angles at 2.0 meter centres
e)	1251 & above	1.25 (18G)	1.80	40x40x3mm girth MS angles at 1.2m centres

4.3.2 The seams on round ducts may be continuously welded or grooved longitudinal seam. In case of welding of GI sheet, zinc rich paint shall be applied on the welded zone.

4.3.3 Round ducts shall either be joined by welding or the ducts shall be swedged 40mm from the ends such that larger end will butt against the swedge and is held in place with sheet metal screws.

4.4 DUCT SUPPORTS

Unless specified otherwise on drawings, rectangular ducts with larger side of 2250mm or above shall be supported by 15mm MS rods and 50x50x3mm and MS angles while those below 2250 mm shall be supported by 10mm MS rods and all angles shall be given a coat of primer paint. The duct supports shall be at a distance not exceeding 1800mm. The MS rods shall be fixed to MS angle cleats, which in turn are fixed to ceiling slab by suitable anchor fasteners. All anchor fasteners, MS angle cleats, coach screws, hooks and other supporting material required shall be provided by vendor.

However, If ducts are thermally insulated, the MS angles and supports shall not be in



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 5 OF 9

direct contact with ducts, for which purpose wooden pieces/ Resin bonded fibre glass sheets (50 mm thick) shall be used in between.

4.5 FLEXIBLE CONNECTIONS

Wherever the sheet metal ducts connects to intake or discharge of fan units a flexible connection of at least 150mm width made by closely woven double layer Fire resistant or canvas shall be provided. The same shall be attached to angle iron frames on equipment and to similar frame on duct or casing by means of a steel band 9r (or) collar fitting over the end of the flexible connection and bolted through angle iron frame so as to clamp securely between the band and the angle frame.

4.6 TRANSFORMATIONS AND BREACHES

All curves, bends, offsets and other transformations shall be made for easy and noiseless flow of air. The throat of every branch duct shall be sized to have a velocity not exceeding that in the main duct to which the branch is connected.

4.7 CAULKING

Wherever duct passes through wall, the opening between masonry and duct work shall be neatly caulked or sealed to prevent movement of air from one space to adjoin by space with a rated fire resistant material.

4.8 EASEMENT

Normally pipe hangers, light fitting rods etc. shall not be allowed to pass through the ducts. Wherever, It becomes absolutely essential to pass these hangers/rods etc. Through the ducts, prior approval of purchaser shall be taken and light streamlines easement around the same shall be provided to maintain smooth air flow.

4.9 ACCESS DOORS

Access doors shall be provided in ducts, plenums etc. on both sides to allow access and servicing of equipment viz. pipes, dampers, coils, valves, heaters etc.


All access doors shall be adequately sized and lined suitably with felt to prevent air leakage. The doors shall be of built-up construction, structurally strong and shall have at least two hinges each, and shall be with two rust proof window sash locks of approved type. All doors shall be so set as to flush with outer finish of duct insulation etc.

4.10 DAMPERS AND SPLITTERS

4.10.1 Dampers and splitters shall be provided at suitable points for proportional volume control of the system. Splitters and dampers shall be made of minimum 18 gauge GSS of quadrant type with locking device mounted outside the duct at accessible location.

4.10.2 FIRE DAMPERS

Fire dampers shall be provided as specified in Data Sheet -A and shall be installed at locations indicated on drawings and/or as required/approved by purchaser, including all openings in passage of duct work through fire walls and floors etc. The fire damper shall be of electrical type with damper motor actuated by thermal

	TECHNICAL SPECIFICATION	SPECIFICATION NO.PES-553-07
	LOW PRESSURE AIR DISTRIBUTION SYSTEM	VOLUME II B
		SECTION D
		SHEET 6 OF 9
	<p>sensor or fusible link type.</p> <p>4.10.3 VANES</p> <p>Unless otherwise shown in the drawings all elbows shall be such that the throat radius is 75% of the duct width. In case throat radius is smaller, suitable single thickness vanes of approved details shall be provided.</p> <p>4.10.4 FLASHING</p> <p>For the ducts penetrating roofs or outside walls, provision of flashing shall be made by the ducting vendor.</p> <p>4.11 DIFFUSERS AND GRILLS</p> <p>The type and quantity of diffusers and grills is indicated on enclosed drawings/data sheet A. The size/quantity of diffusers/ grills indicated in the drawing/data sheet is indicative and is for vendor's reference purpose only. Vendor shall ensure that the diffusers/grills offered are of requisite capacity, throw and terminal velocity. The pressure drop and noise levels shall be as per data sheet. A enclosed. The diffusers/grills shall be approved by purchaser.</p> <p>Unless specified otherwise the diffusers/grills shall be of mild steel land painted with two coats of primer paint. Supply air grills shall be complete with volume control dampers. Supply air grills shall be double deflection type while Return Air grills can be single deflection type. Ceiling outlets/diffusers shall have volume control dampers, fixed grids and blanking baffles. All volume control dampers shall be operated by a key from the front of grills/diffusers.</p> <p>Suitable vanes shall be provided in duct collars to have uniform air distribution. Blank-off baffles wherever required, shall also be provided.</p> <p>4.12 PLENUMS AND RA BOXING</p> <p>All plenum chambers and/or connections to fans, dampers etc. shall be constructed in 18 gauge GI sheet. supported on 40x40x6mm MS angle frames. All vertical angles shall be riveted at appox. 125mm. centres to the casing. Suitable caulking compound (Pecora or equivalent) shall be inserted between the base of the angle and all masonry construction to which angles are fastened.</p> <p>Return air boxing requirements if any are indicated in data sheet-A and the same shall be provided by vendor. The return air box shall be fabricated out of GI sheets shall be insulated with 25mm thick fibre-glass.</p> <p>4.13 ACCOUSTIC LINING</p> <p>The ducts shall be lined acoustically from inside as given in data- sheet A and/or section C of the specification.</p> <p>4.14 PAINTING</p> <p>Wherever specified the ducts shall be painted or lined with suitable anti-corrosive paint/ lining as per approval of purchaser. In particular the ducts coming in contact with acid fumes shall be epoxy coated, inside and outside.</p>	



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 7 OF 9

- 4.15 **THERMAL INSULATION**
- Thermal insulation shall be as per data sheet - A and the insulation shall conform to enclosed spec. no. PES-553-08.
5. **INSPECTION AND TESTING**
- 5.1 **INSPECTION & TESTING DURING FABRICATION**
- 5.1.1 Visual inspection of GI sheets and angles, channels etc. – dents, black spots, chipping of zinc coating, white dust on galvanised sheets shall be avoided. Pitting, lamination in angles and channels shall be avoided.
- 5.1.2 Galvanised sheets - Test certificate shall be furnished for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating.
- 5.1.3 Check for dimensions & mass as per latest IS-277.
- 5.1.4 Check for defect, twists, ungalvanised spots as per IS-2629.
- 5.1.5 Bend test & wrapping test as per IS-277.
- 5.1.6 Zinc coating test on samples as per IS-6745.
- 5.2 **INSPECTION & TESTING AT SITE.**
- 5.2.1 The duct branches, elbows etc. shall be inspected and the joints and connections etc, are to be checked before they are assembled in position.
- 5.2.2 After completion, all duct systems shall be checked and tested for air leakage, tightness, velocity, pressure drop, vibration and noise etc.
6. **BALANCING**
- 6.1.1 The entire air distribution system shall be balanced by vendor to supply the air quantities as required in various rooms so as to maintain the requisite temperature and air flow in the conditioned spaces. The final balance of air quantities through each grill/diffuser etc. shall be recorded and submitted to purchaser for approval. Proper steps shall be taken to have a uniform temperature in all enclosures, with utmost care for noise level to be within tolerance limit
- 6.1.2 All instruments required for testing/balancing etc. of the air distribution system shall be provided by vendor.



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 8 OF 9

7. DATA TO BE FURNISHED BY VENDOR AFTER THE AWARD OF CONTRACT

- 7.1 Fabrication drawings of ducts and grilles, louvers, dampers, etc, including typical details of grilles dampers etc.
- 7.2 Test certificates in line with scope of inspection.
- 7.3 Other dimensional drawings & documents as may be required by purchaser for better understanding of the system & for preparation of operation, maintenance & instruction manual.



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

SHEET 9 OF 9

**LOW PRESSURE AIR DISTRIBUTION SYSTEM****DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 2

Description**Data**

- | | | |
|--------------------------------|---|---|
| 1. General (List of areas) | | : As per Specification/Tender drawing. |
| 2. GSS Duct Work | | |
| a) Type | | : GSS as per IS: 277
(Zinc coating as per Section-C of
Specific Technical Requirements.) |
| b) Size | | : As per Section-C of Specific Technical
Requirements and bill of quantity. |
| 3. Acoustic lining | | : Up to 5m length from AHU Outlet. |
| 4. Special painting | | : Galvanised. |
| 5. Thermal Insulation | | : Required in supply air duct in AC
entire length. |
| 6. Diffusers (Circular/Square) | } | |
| 300 mm size | | |
| 350 mm size | | |
| 450 mm size | | |
| 550 mm size | | |
| 600 mm size | | |
| Any other size | | : Bidder to estimate as per
drawings./specification.
All grille frame and louvers shall be
manufactured of at least 16 SWG Aluminium |
| 7. SA grilles (for each size) | | : To suit air flow as per System
requirements / Tender Drawings. |
| 8. RA grilles (for each size) | | : -do- |

NOTE:

1. Duct sheet thickness shall be as per IS-655
2. Opposed blade type volume control damper shall be provided at each supply air diffusers/grilles.
3. Bidder to provide suitable gasketing at each duct flange.
4. Fire damper shall be motor operated type, when otherwise specified under Section-C.
5. Access door in ducting system shall be provided as required.
6. MS Angle (painted) shall be used for duct supports etc.
7. Velocity thru duct shall normally not exceed 9.0 M/sec for Air conditioning system. Maximum velocity (outlet) for supply air diffuser shall not exceed 2.5 m/sec.



LOW PRESSURE AIR DISTRIBUTION SYSTEM

DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 2 OF 2

8. All Grilles & diffusers shall be supported with frame. Frame etc. shall be supplied by bidder.



TECHNICAL SPECIFICATION

CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

SHEET 1 OF 10

**STANDARD TECHNICAL SPECIFICATION
FOR
CENTRIFUGAL PUMPS**



TECHNICAL SPECIFICATION

CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

SHEET 2 OF 10

1. GENERAL

1.1 This specification covers the design, material, constructional features, manufacture, assembly, inspection and testing at manufacturer's or his subcontractor's works, suitable painting requirements of centrifugal pumps and drives complete with all accessories as specified hereinafter.


2. CODES AND STANDARDS

2.1 The design, manufacture, inspection, testing & performance of the pumps as specified hereinafter, shall comply with the requirements of the latest revision of the following standards as indicated below (as applicable):

- 2.1.1 IS-1520 : Horizontal centrifugal pumps for clear, cold and fresh water.
- 2.1.2 IS-5120 : Technical requirements - Rotodynamic special purpose pump.
- 2.1.3 IS-1710 : Vertical turbine pumps for clear, cold and fresh water.
- 2.1.4 BS - 599 : Method of testing Pumps.
- 2.1.5 PTC - '6' : Centrifugal Pumps Power test code
- 2.1.6 API - 610
- 2.1.7 Hydraulic Institute Standards of USA

Wherever standards for certain aspects materials etc., not mentioned, the same shall be as per the applicable Indian or International standards.

2.2 In case of any conflict between the above codes/standards and this specification, the later shall prevail and in case of any further conflict in this matter, the decision of Purchaser's engineering shall be final and binding.

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04
		VOLUME II B
		SECTION D
		SHEET 3 OF 10

3. DESIGN REQUIREMENTS

- 3.1 The pumps shall be of heavy duty suitable for long periods of uninterrupted service and shall be standard product of the manufacturer thoroughly proven for satisfactory performance and reliability.
- 3.2 The materials of construction of various components shall be as indicated under Data Sheet-A and where not specified to the applicable Indian/British/American standards..
- 3.3 All pressure containing components including the pump casing, nozzles and stuffing box housing shall be designed, fabricated and tested in accordance with applicable Indian standards if not specified otherwise.
- 3.4 The pump shall be suitable for handling the fluid as specified in Data Sheet-A.

4. CONSTRUCTION FEATURES:

4.1 PUMP CASING


- 4.1.1 Pump casing may be axially or radially split or barrel type construction as specified in the pump data specification sheet. The casing shall be designed to withstand 1.5 times the maximum pressure developed by the pump at the pumping temperature.
- 4.1.2 Pump casing shall be provided with adequate number of vent and priming connections with valves, unless the pump is made self venting & priming. Casing drain, as required, shall be provided complete with drain valves or plugged with threaded plugs as required.
- 4.1.3 Pump shall preferably be of such construction that it is possible to service the internals of the pump without disturbing suction and discharge piping connections.
- 4.1.4 Under certain conditions, the pump casing nozzles will be subjected to reactions from external piping. Pump design must ensure that the nozzles are capable of withstanding external reactions not less than those specified in API-610

4.2 IMPELLER

- 4.2.1 Unless specifically indicated under Data Sheet-A enclosed, the pump impellers shall be of closed vane type. The impellers shall be secured to the shaft and shall be retained against circumferential movement by keying, pinning or lock rings. Impellers shall be checked for eccentricity and statically and dynamically balanced individually. The assembled rotor shall be dynamically balanced and checked for eccentricity. Supplier shall ensure during balancing that wall thickness of impeller vane, shroud etc is maintained above the minimum thickness requirement as per design.

4.3 WEARING RING

- 4.3.1 Renewable wearing rings for the casing and/or the impellers and renewable shaft sleeves, shall be provided for all pumps. Length of the shaft sleeves must extend

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04
		VOLUME II B
		SECTION D
		SHEET 4 OF 10

beyond the outer faces of gland packing or seal and plate so as to distinguish between the leakage between shaft & shaft sleeve and that past the seals/gland.

4.4 SHAFT

4.4.1 Shaft size selected shall take into consideration the critical speed which shall be away from the operating speed as recommended in applicable Code/Standard. The critical speed shall also be at least 10% away from runaway speed.

4.5 BEARING

4.5.1 Bearings and hydraulic devices, of approved make, (if provided for balancing axial thrust) of adequate design shall be furnished for taking the entire pump load arising from all probable conditions of continuous operation throughout its Range of Operation and also at the shut off condition. The bearing shall be designed on the basis of 20,000 working hrs minimum for the load corresponding to the duty point. Proper lubricating arrangement for the bearings shall be provided. The design shall be such that the bearing lubricating element does not contaminate the liquid being pumped. Where there is a possibility of liquid entering the bearing, suitable arrangement in the form of deflectors or otherwise shall be provided ahead of bearing assembly. Bearings shall be easily accessible without disturbing the pump assembly.

4.6 STUFFING BOX

4.6.1 Packed type stuffing boxes of adequate depth with lantern rings shall be provided to minimize the leakage. In all cases where the pump suction is below atmospheric pressure, the shaft packing shall be sealed by the liquid pumped by tapping off from the pump discharge itself and all pipes, valves, fittings etc., required for this shall be furnished by the manufacturer. Tubings used for connections shall be flexible metallic type preferably SS-304/316. PVC/ rubber tubings are not acceptable.

4.7 SHAFT COUPLING

4.7.1 The pumps shall be directly coupled to their drives through heavy-duty flexible coupling. Suitable sturdy coupling guards of min. 1.5 mm MS sheet/ Aluminium sheet shall be provided along with the coupling. The pump and its drive motor shall be mounted on a common base plate.

4.8 BASE PLATE AND SOLE PLATE

4.8.1 Unless otherwise stated the data specification sheet, a common base plate mounting both for the pump and drive shall be furnished. The base plate shall be of rigid construction, suitably ribbed and reinforced. Base plate and pump supports shall be so constructed and the pumping unit so mounted as to minimize misalignment caused by mechanical forces such as normal piping strain, hydraulic piping thrust, etc. Suitable drain taps and drip lip shall be provided. The external corners of the base plate shall be rounded to avoid sharp corners. Drilled holes shall have sufficient space around for proper seating of washer with nut. If required in the data specification sheet, steel sole plates shall be provided, below the base plate.



TECHNICAL SPECIFICATION

CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

SHEET 5 OF 10

4.9 PRIME MOVER

4.9.1 The drive motor selected shall conform to the requirements of the enclosed motor specifications.

4.10 LIFTING ARRANGEMENT

4.10.1 Each pump and motor shall incorporate suitable lifting attachments e.g. lifting lugs or eye bolts etc., to facilitate erection and maintenance..

5. PERFORMANCE REQUIREMENTS

5.1 The pump shall be designed to have best efficiency at the specified duty point. The pump set shall be suitable for continuous operation at any point within the Range of Operation as stipulated in the data specification sheets.

5.2 Pump shall have a continuously rising head capacity characteristics from the specified duty point towards shut off point, the maximum being at shut off. Power capacity characteristic will be non-overloading type i.e. 110% of the design flow the power required to drive the pump will be practically the same as that at the design flow.

5.3 Wherever specified in data sheet, pumps of each category shall be suitable for parallel operation. The head vs capacity, input power vs. capacity characteristics, etc., shall match to ensure equal load sharing and trouble free operation throughout the range.

5.4 The pump motor set shall be designed in such a way that there is no damage due to the reverse flow through the pump which may occur due to any malfunction of the system.

6. DRIVE RATING

6.1 The power rating of the drive shall be selected such that a minimum margin of 15% is available over the pump input power required at the rated duty point. However, the drive rating shall not be less than the maximum power requirement at any point within the 'Range of Operation' specified.


6.2 In cases where parallel operation of the pumps are specified the actual drive rating is to be selected by the bidder considering overloading of the pumps in the event of tripping of one of the operating pumps.

6.3 The bidder under this specification shall assume full responsibility in the operation of the pump and the drive as one unit.

7. SCOPE OF INSPECTION AND TESTING

7.1 CASTING

7.1.1 The Witnessing pouring and thereafter physical testing of castings of 'Critical' nature such as casings, impellers, diffusers. Castings shall have 'as cast' heat numbers

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04
		VOLUME II B
		SECTION D
		SHEET 6 OF 10

unless they require overall machining. For partially machined components manufacturer shall ensure availability of as cast heat nos. on unmachined area.

- 7.1.2 Identification and correlation with test reports for all tests as per the relevant material specifications for castings of 'Major' nature such as suction bell, discharge elbow, stuffing box, gland, wearing rings, shaft sleeves etc.
- 7.1.3 Foundry's conformity certificate for castings of 'Minor' nature such as base plates, covers etc.
- 7.1.4 Verification of Heat treatment charts (as applicable)
- 7.1.5 Castings may be required to meet NDT requirements such as Radiography, Magnetic Particle Testing or Dye-penetrant testing prior to Hydro-test as per requirements specified in Quality Plan.
- 7.1.6 Surface finish of Steel castings shall meet MSS SP-55.

7.2 **FORGING**


- 7.2.1 Identification and correlation with mill test certificates for all tests as per the relevant specifications for important forgings like casings, stage bodies, diffusers, shaft material.
- 7.2.2 Verification of heat treatment charts (time temperature) (as applicable).
- 7.2.3 Forgings may be required to meet NDT requirements such as Radiography, Magnetic Particle Testing or Dye-penetrant testing prior to Hydro-test as per requirements specified in Quality Plan.


7.3 **FABRICATED ITEMS**

- 7.3.1 Identification and correlation with mill test certificates for material of items such as discharge bellows, column pipes etc.
- 7.3.2 Approval of welding procedure specifications and qualifications of weld procedures and personnel as per ASME Sec IX.
- 7.3.3 Dye penetrant tests of weldment as per ASTM E-165 and acceptance norm as per ASME Sec.VIII, Div.1, Appendix 8
- 7.3.4 Verification of heat treatment charts (time temperature), (as applicable)
- 7.3.5 **Note:** For para 7.1.2, 7.2.1 and 7.3.1 above; in case correlating original test certificates are not available, material shall be identified by Main Vendor and test conducted at NABL approved Laboratory.

7.4 **IN PROCESS INSPECTION AND TESTING**

- 7.4.1 Identification Dye penetrant testing after machining for impellers including vanes, pump shaft, diffusers as per applicable code; in absence of which, as per ASTM E - 165. Permissible defects and acceptance norms need to be specified. On static parts acceptance norms are as per ASME Sec.III NB 2546.
- 7.4.2 Ultrasonic testing of dynamic duty component, i.e. pump shafts (50mm dia and above) and static duty forgings i.e. Barrel, casting (15mm and above wall thickness)

	TECHNICAL SPECIFICATION	SPECIFICATION NO.PES-553-04
		VOLUME II B
	CENTRIFUGAL PUMPS	SECTION D
		SHEET 7 OF 10
	<p>as per applicable code, in absence of which as per ASTM E388 and acceptance norms as stipulated hereunder. Probe shall be of min. 2 MHz frequency.</p>	
7.4.3	<p>Acceptance norms for UT for dynamic duty components. the following defects are unacceptable</p> <ul style="list-style-type: none"> a) Cracks, flakes, seams and laps b) Defects giving indications longer than that from a 4mm equivalent flaw. c) Group of defects with maximum indications less than that from a 4mm equivalent flaw, which cannot be separated at testing sensitivity, if the back echo is reduced to less than 50%. d) Defects giving indications of 2 to 4mm dia. equivalent flaw separated by distance less than four times the size of the larger of the adjacent flaw. 	
7.4.4	<p>For static duty components - as per NB 2542.2 of ASME Sec. III</p>	
7.4.5	<p>Hydro tests of all pressure parts such as casings, column pipes, discharge elbows etc., at two times duty point pressure or 1.5 time shut off pressure, whichever is higher for 30 min., without any leakage.</p> <p>Note : In case the pump is required to boost certain pressure, the inlet pressure head shall also be taken into consideration to compute test pressures</p>	
7.4.6	<p>Static and dynamic balancing of individual impellers and also assembled rotors as per V.D.I. 2060 Q 6.3 or ISO 1940 G 6.3.</p>	
7.5	<p>PERFORMANCE TEST</p>	
7.5.1	<p>Pump testing with unit supply motor as per specifications and acceptance norms cited elsewhere, in absence of which as per IS 5120 latest edition. Performance shall be checked for minimum of 7 points (including shut off head and over load) following characteristics shall be checked.</p> <ul style="list-style-type: none"> a) Capacity V/s Head b) Capacity V/s Power absorbed by pump c) Capacity V/s pump efficiency <p>Note : For pump of fire protection system, performance test shall be conducted up to 150% of rated capacity.</p>	
7.5.2	<p>NPSH test in case specifically mentioned elsewhere.</p>	
7.5.3	<p>Vibration, noise level and temperature rise measurement. Noise level shall be within 85dB(A) at 1 metre distance. Vibration within satisfactory zone of VDI 2056 Group G machines. Temperature shall not exceed ambient + 40 deg. C.</p>	
7.5.4	<p>Overall dimensions as per GA drawings. One pump/type/size assembly with job motor shall be mounted on base plate, provided the components are ordered on the same manufacturer.</p>	
7.5.5	<p>Examination after selective opening up after running for pumps operating at speed over 1800 rpm and capacity exceeding 68M3/hr.</p>	
7.5.6	<p>Painting and packing as per technical specification.</p>	

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04
		VOLUME II B
		SECTION D
		SHEET 8 OF 10

7.6 TEST AT SITE


7.6.1 The pumps will be tested at site by the purchaser to verify their performance. If the pumps fail to operate smoothly or within the required performance all such deficiencies shall be rectified by the manufacturer by making suitable alternatives in the pump set and additional tests required to show the effect of such alterations shall be performed by him.

7.7 PERFORMANCE GUARANTEE

7.7.1 The vendor shall guarantee the material and workmanship of all components as well as the operation of the pump as per requirement of this specification. The vendor shall also guarantee for each pump the total dynamic head at the specified rated capacity and also corresponding efficiency, brake horse power and shut off head

8. CLEANING, PROTECTION , PAINTING & PACKING

8.1 Before shipment of the equipment to be supplied under this specification the necessary cleaning, flushing etc., as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere shall be done to remove all dirts, scales etc. Shop coats of rust inhibiting paints, lacquers etc., shall be applied to various parts as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere. Flanges, inlet and outlet pipe, etc shall be protected. Packing shall be done as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere.

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04
		VOLUME II B
		SECTION D
		SHEET 9 OF 10

9. DRAWINGS, TECHNICAL DOCUMENTS AND OTHER INFORMATION REQUIRED WITH THE PROPOSAL

- 9.1 Fully dimensioned outline GA drawings of the pump motor assembly unit for each type and size offered. This drawing should include:
- a) Foundation base plate and sole plate details as applicable
 - b) Civil foundation and anchor bolts details and loading data
 - c) Minimum submergence required for the pump (if applicable)
- 9.2 Cross sectional drawing of the equipment showing the details of assembly of components and their material of construction and/ make with standard applicable codes.
- 9.3 Performance characteristics (Discharge capacity vs head, BHP and efficiency of the pumps.
- 9.4 Motor speed torque curve superimposed on pump speed torque curve. Required NPSH of pump.
- 9.5 Experience list about the supply and successful operation of similar pumps for similar application.
- 9.6 A comprehensive write up or brochure on the details of manufacturing and testing facilities in the shop of the manufacturer.
- 9.7 Quality plan for the equipment being offered, in BHEL format as practiced in the manufacturer's works and Field Quality Plan for receipt, storage erection, commissioning & testing at site.
- 9.8 Data sheet-B with all the particulars filled in.

10. MANUFACTURERS NAME AND TAG. PLATES

- 10.1 Each pump shall have a permanently attached brass/ Stainless steel tag on the body indicating the following information both in Hindi and English:
- a) Manufacturer's name and trade mark.
 - b) Design Capacity and Head.
 - c) Design.
 - d) Purchaser's tag no. as furnished during the contract. The purchaser's tag no. will be indicated by the Purchaser on the drawing submitted for approval by the vendor.



TECHNICAL SPECIFICATION
CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

SHEET 10 OF 10

11. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

- 11.1 Certified GA drawings of pump motor assembly weights, crane.
- 11.2 Detailed cross sectional drawings of the pump and motor assembly and all equipment & accessories supplied under the this specification along with details of material of construction with applicable standard codes.
- 11.3 Foundation drawings with details of foundation pocket indicating static as well as dynamic load and other data with dimensions.
- 11.4 Certified characteristics curves (discharge capacity vs. head, BHP and efficiency) of each type of pump and motor.
- 11.5 Material and other test certificates as required by the application clauses of this specification.
- 11.6 Motor speed torque curves super imposed on pump speed torque curves.
- 11.7 Quality plan along with complete details of testing and inspection requirements of centrifugal pumps in BHEL format. Vendor shall also furnish Field Quality Plan.
- 11.8 Installation , operation and maintenance manual.
- 11.9 Other drawings and data, if necessary.



CENTRIFUGAL PUMPS
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 2

DESCRIPTION

DATA

- | | |
|------------------------------------|---|
| 1. Designation | : Condenser water and Chilled Water pumps for AC plant. |
| 2. Type | : Horizontal, Centrifugal pump or vertical split type casing pump . |
| 3. Quantity | : Refer to section-C of Specific Technical Requirements |
| 4. Installation | : On floating type foundation. |
| 5. Fluid to be handled | : Water |
| 6. Temperature of fluid | : To suit. |
| 7. Capacity M3/hr and TDH at rated | : To suit system requirements but head shall not be less than 25 MWC. |
| 8. Duty | : Continuous (24 hours / day) |
| 9. Suction condition | : Flooded |
| 10. Type of drive | : Direct |
| 11. Prime Mover | : LV AC motor |
| 12. Maximum speed | : 1500 RPM |
| 13. Type of lubrication | : Grease Lubrication |
| 14. Material | |
| a) Impeller | : Bronze to Grade IS: 318 Grade 2 |
| b) Pump shaft | : EN - 8 / Equivalent (Approved). |
| c) Casing | : CAST IRON TO IS: 210 Grade - 260. |
| d) Wearing ring | : Bronze to Grade IS:318 GR-2, Renewable type. |
| e) Shaft Sleeve | : -do- |
| f) Base plate | : Cast Iron to Grade FG-200 IS-210/M.S. fabricated. |
| g) Bolt and nuts. | : MS |
| h) Stuffing Box gland/bush case. | : Deep Bronze packing to be renewable with case. |



CENTRIFUGAL PUMPS
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 2 OF 2

- i) Stuffing box Packing. : Flexible Graphite or PTFE (Asbestos shall not be used)
- j) Pump motor coupling. : Flexible.

15. **ACCESSORIES REQUIRED:-**

The following accessories shall be provided by the bidder for each pump:

- a) Suction & Discharge pressure gauges. : Yes.
- b) Vent connection : Yes.
- c) Drain piping up to common drain point in plant room. : Yes
- d) Companion flanges. : Yes
- e) Common base plate. : Yes.
- f) Suction strainer. : Yes
- g) Isolating valve : Yes
- h) NRV at pump outlet at inlet/outlet : Yes
- i) Any special requirements : The Chilled Water pumps shall be suitably insulated as per spec.
- j) Inspection & Testing : As per specification enclosed elsewhere.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 2 OF 6

1 GENERAL

1.1 This specification covers the design, manufacture, inspection and testing at the manufacturer's works and suitable packing delivery and testing of the packaged air conditioning unit.

2 CODES AND STANDARDS

2.1 The design, manufacture, inspection, testing and performance of the packaged type air conditioning unit shall comply with all statutes, regulations and safety codes currently applicable in the locality where the equipment will be installed. The equipment shall also conform to the latest editions of the codes and standards specified herein under. Nothing in this specification shall be construed to relieve the vendor of this responsibility.

In particular, the packaged air conditioning Unit (max 7.5 TR capacity, ductable or non ductable type) or cassette type (up to 5 TR) shall conform to the latest editions of the following standards:

- 2.1.1 I.S.660 : Safety code for Mechanical Refrigeration.
- 2.1.2 I.S.5111 : Code of practice for measurement, and testing of refrigerant compressor.
- 2.1.3 I.S.659 : Safety code for air conditioning.
- 2.1.4 I.S.2494 : V Belt for industrial purpose.
- 2.1.5 I.S.3142 : V grooved pulleys for V Belts.
- 2.1.6 I.S.4503 : Shell and tube type heat exchanger.
- 2.1.7 ARI 210 : Standard for/unitary air conditioning equipment
- 2.1.8 ARI 270 : Standard for application installation and servicing of unitary equipment.
- 2.1.9 ASHRAE-37 : Standard methods of testing for rating unitary air conditioning and heat pump / equipment.
- 2.1.10 ANSI-B9-1 : Safety code for mechanical refrigeration.

3 DESIGN AND CONSTRUCTIONAL REQUIREMENTS

3.1 Compressor

The compressor shall be hermetic or semi-hermetic or screw rotary type or scroll type. The same shall be suitable for R410A/R407C/R134A refrigerant. The compressor shall be mounted on anti-vibration spring/rubber pads and shall be positioned in such a way that it is freely accessible with sufficient space all around for easy maintenance. Safety controls like High and Low pressure cut-out overload and single phasing protection for the motors shall be provided. A crankcase heater shall also be provided, if considered necessary by the vendor.

3.2 CONDENSING UNIT

Shell and tube type water cooled condenser or air cooled condenser with adequate area shall be provided as specified in Data Sheet-A. The condensing unit shall be complete with



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 3 OF 6

multipass heads and shall be fitted with the following:

- 3.2.1 Hot gas inlet and liquid outlet connection with shut off valve for liquid.
- 3.2.2 Drain plug, air vent and test valve.
- 3.2.3 Water inlet and outlet connection with thermowell and suitable cocks respectively.
- 3.2.4 Relief valve and air purge valve (Fusible plug in place of relief valve not acceptable)
- 3.2.5 Any other accessory as recommended by the manufacturer for proper functioning of the equipment.

3.3 AIR HANDLING FAN

The air handling fan shall be of the centrifugal type and with forward curved blades. This shall be driven by means of a three phase induction motor through V belt drive. The fan static pressure shall be selected for passing air through high efficiency absolute filters, if specified in Data Sheet-A.

3.4 FILTERS

Filters shall be of dry panel type and shall be cleanable. The velocity of air across the filters shall not exceed 1.75m/sec (350FPM).

3.5 COOLING COIL

The cooling coil shall be of direct expansion type and shall be made of heavy gauge copper with aluminium fins. The fins shall be bonded to the copper tubes under hydraulic pressure. A distributor shall be provided for feeding the refrigerant to different sections of the coil. Rows shall be staggered in the directions of airflow. The velocity of air across coil shall not exceed 2.5M/Sec. (500 FPM).

3.6 CONTROLS

All necessary controls and accessories like thermostatic expansion valve, refrigerant solenoid valve, distributor, filter drier in the liquid lines, shut off valves, HP/LP cut out for compressor, thermostat with adjustable settings, overload and single phasing preventer for motor etc. are to be provided. The microprocessor based control panel shall be provided outside the packaged unit on one side. The control panel shall generally be in line with the specification for control panels given elsewhere.

The control shall be so interlocked that the fan shall be started independently first, and then only the compressor. Tripping of the compressor by the thermostat or compressor cut outs shall not trip the fan. The thermostat setting shall be adjustable

3.7 REFRIGERANT PIPING

The refrigerant piping shall be either heavy gauge copper as furnished in Data Sheet-A. The piping shall be completely factory assembled, pressure tested, dehydrated and initially charged with FREON gas and compressor oil. The line accessories shall include liquid line shutoff valve dehydrator, strainer, flow indicator and distributor etc.

3.8 CABINET

All the equipments, except control panel, mentioned above shall be provided within a heavy gauge sheet metal cabinet, of floor/ wall mounted type. This shall be given two coats of anti-corrosive and rust proof paint, finished with two coats of final paint . Painting shall be as per manufacturers std unless specified otherwise in data sheet 'A'. The interior of the cabinet shall be provided with thermal and acoustic insulation of minimum 25mm thick. The insulating material shall be fire proof.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 4 OF 6

The front and back side of the cabinets shall be easily removable providing maintenance to all the interior parts.

All the electric wires within the cabinet shall run in flexible conduits and carry identification tags. The bottom side of the panel shall be specially ribbed to take care of the transportation.

3.9 OTHER ACCESSORIES

Each packaged air conditioner shall be provided with required number of neoprene rubber isolating pads.

4 CONTROL AND INTERLOCK REQUIREMENTS

The compressor shall have all protective devices like HP/LP cutouts, overload protection for the motor, single phasing preventor for motor etc.

The interlocking requirement shall be as indicated below:

4.1 The compressor shall not start, unless condenser water flow is achieved for water cooled condenser. The condenser flow shall be sensed by means of a flow switch.

4.2 The compressor shall not start unless the evaporator fan is started.

4.3 The tripping of compressor on HP/LP, overload or on thermostat shall not trip the fan.

4.4 Strip heater (if provided in the ducting system) shall not be switched on, unless the evaporator fan is started and airflow is established. For this purpose, an air stat on flow switch shall be used. The heater shall be separately controlled by humidistat/thermostat

4.5 A humidifying package, if specified in data sheet A, shall be controlled by humidistat.

5 TEST AND INSPECTION

5.1 Inspection and Testing at Manufacturer's Works

5.1.1 static and dynamic test for fans

5.1.2 Hydrostatic static test on condenser and cooling coil.

5.1.3 vacuum/pressure test for the complete refrigeration circuit.

5.1.4 Visual and Free running test of the packaged unit on test bed.

5.1.5 Free running test on compressor.

5.1.6 AIR CAPACITY WITH ANEMOMETER.

5.1.7 NOISE LEVEL- ≤ 85 dB(A).

5.1.8 Other tests as per approved qualities plan/scope of inspection.

5.2 Inspection and Testing at Site

5.2.1 Performance testing of the packaged unit for 72 hours in summer / monsoon & 24-hours in winter- Up-to 3 TR (individual M/c capacity) inside room temperature (Dry & wet bulb) will be checked with all machines in the room operating.

The actual days of testing shall be mutually agreed. During the above testing, the following readings shall be taken to compare the same with guaranteed performance data.

5.2.1.1 Condenser inlet and outlet pressure and temperature

5.2.1.2 Entering and leaving air temperature of the cooling coil air filters.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 5 OF 6

- 5.2.1.3 Motor current for the compressor and blower.
- 5.2.1.4 Air quantity delivered by the fan. This shall be computed by adding air quantity leaving all the grilles entering the air filters.
Room temperature (Dry & wet bulb)
- 5.2.1.5 Test to ensure all controls and safety instruments are working properly.
During the above testing, noise level also will be checked to ensure that the same are within acceptable limits. Any undue vibration detected physically will be corrected.
All tools and instruments required for the above testing will be provided by the vendor.

6 PAINTING:

The packaged unit shall be given two coats of primer paint finished with two coats of finish paint as per Manufacturers std. unless specified otherwise elsewhere/ Data sheet 'A'. The colour of finish paint will be as specified in Data Sheet-A.

7 GUARANTEES

The package unit shall be guaranteed for performance measured in terms of the inside temperature maintained.

The packaged unit shall also be free from any manufacturing defects and shall be guaranteed as per contract after the first test as per 5.0 is successfully carried out, and the plant taken over by the purchaser.

8 NAME PLATES

Suitable Name plate as per Data Sheet 'A', depicting the equipment number as designated in Data Sheet A shall be provided for each packaged unit and screwed to a prominent position on the packaged unit.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

SHEET 6 OF 6

9. DATA TO BE FURNISHED AFTER AWARD OF CONTRACT

- 9.1 Final technical data as per Data Sheet-B
- 9.2 G.A. and interior view of packaged unit
- 9.3 Electrical wiring diagram
- 9.4 Catalogues for all controls
- 9.5 O & M Manual
- 9.6 Erection Manual



PACKAGE-CONDITIONING UNIT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 1

DESCRIPTION

DATA

- | | | |
|-----|--|---|
| 1) | Capacity of the unit at operating conditions. | : As specified |
| 2) | Numbers required | : Refer to Section-C of Specific Technical Requirements |
| 3) | Designation of the unit | : Package AC Unit |
| 4) | Whether air cooled/water cooled | : Refer to Section-C of Specific Technical Requirements |
| 5) | The plant shall be suitable for maximum-ambient temp. | : Refer outdoor design condition as specified. |
| 6) | Whether a plenum Chamber required | : Units shall be connected to fresh air ducts. |
| | OR | |
| | Whether to be connected duct system. | : Yes. |
| 7) | Whether Humidifier required for humidity-control. | : Refer to Section-C of Specific Technical Requirements |
| 8) | Whether strip heaters required for winter heating. | : Refer to Section-C of Specific Technical Requirements |
| 9) | Whether strip heater required for Humidity control. | : Refer to Section-C of Specific Technical Requirements |
| 10) | Final painting colour shade stage. | : Subject to approval / during detail engineering stage. |
| 11) | Whether fan static pressure is to be designed for filters arrangement shown. | : Yes. |
| 12) | Installation supporting structure/ drain piping, insulation. | : Required. Drain piping with insulation up to the nearest drain point. |
| 13) | Controls & Instruments | : Yes (Lot) |
| 14) | Isolation Switch | : Yes |



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

SHEET 1 OF 4

**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

SHEET 2 OF 4

1. GENERAL

This specification covers the design, manufacture, inspection and testing at manufacturer's work or his sub-contractor's works of Air filters to be used for air-conditioning and ventilation system.

2. CODES AND STANDARDS

This design, manufacture and performance of AIR FILTERS shall comply with all currently applicable statutes, regulation and safety codes in the locality where the equipment will be installed. The equipment shall also conform to latest applicable Indian/British/USA standards. Nothing in this specification shall be construed to relieve the vendor of this responsibility. The following standards, in particular, shall be applicable for certified ratings of filters and for conducting performance test, if required.

a) BS EN - 779 -Methods of test for air filters used in air conditioning and general ventilation.

3. GENERAL

The enclosed Data sheet A gives the type and other particulars of filters required.

3.1 POLY FIBRE AIR FILTERS

Filtering media shall consist of a suitable fibrous material (e.g. polyethylene extruded sections coir etc.) packed into a 20 gauges GSS framework, complete with handles etc. The filter element shall be supported by galvanised steel wire mesh of 10mm. sq. on either side, Velocity across the filters shall not exceed 2.5 M/sec. Average efficiency Em (%) shall be ≥ 80 as per BS EN - 779.

3.2 DRY FABRIC AIR FILTERS

Filter element shall be pressed felt filter fabric or suitable material recommended by the manufacturer, stitched on to galvanised wire gauge support and crimped to form deep folds. Suitable aluminium spacers shall be provided to ensure uniform distribution of air flow through filters. Filter casing shall be provided with neoprene sponge rubber sealing, The filter shall have Average efficiency Em (%) of ≥ 95 as per BS EN - 779.

3.3 PANEL TYPE METALLIC FILTERS (DRY/VISCOUS)

Filter shall consist of V-fold galvanised wire mesh interspaced with flat layers of galvanised wire mesh. The density of media shall increase in the direction of air flow. Edges of wire mesh shall be suitably hemmed to prevent abrasion during handling. The media shall be supported on either side by galvanised expanded metal casing. The framework shall be at least 18 gauge GSS. Filter shall be either dry or wetted type as per data sheet=A. The oil shall be mineral oil of approved quality and make. As a the filter frame made of Aluminium alloy conforming to IS:737 can be considered unless use of aluminium is prohibited otherwise due to site conditions being saline/corrosive.

All filters shall be capable of being cleaned of their accumulated dust by tap water flushing. The dry metallic filter shall have Average arrestance Am (%) shall be ≥ 90 .



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

SHEET 3 OF 4

However oil wetted air filters shall have Average Efficiency E_m (%) ≥ 90 as per BS EN - 779..

3.4 AUTOMATIC CLEANING FILTERS

This shall consist of a filter mat and drop eliminator, driven by a suitably rated geared motor unit being supported on a steel framework. The filter mat shall consist of an endless steel wire mat insets of steel mesh held between an upper & a lower shall drop eliminator shall consist of an endless steel wire without insets of steel mesh. The unit shall include a suitable oil pump, gludge raking mechanism and sludge container and tensioning device. Pressure drop shall be limited to 0.5 / mm WG when clean & 10 mm when dirty. Air velocity across filter shall not exceed 3 M/sec.

3.5 ABSOLUTE FILTERS

Filters shall be constructed by pleating a continuous sheet of filter medium into closely spaced pleats separated by heavy corrugated aluminium spacers. They shall be individually tested and certified to have an efficiency of not less than 99.97% when tested with 0.3 micron dioctylphalate smoke as per IS:2831. The clean filter initial static pressure drop shall not be greater than 25mm WC at rated capacity. A neoprene sponge rubber sealing shall be provided on either face of filter frame.

3.6 WATER REPELLANT NYLON FILTERS

This shall be constructed of water repellent nylon fabric with continuous water spraying on it from a header for keeping it clean. Efficiency of this filter shall be 85% down to 10 microns. This filter shall be used for unitary air filtration system only.

4. INSPECTION & TESTING

The scope of inspection for air filters shall be as below:

- 4.1 Dimensional inspection of frame & filter media.
- 4.2 Witnessing of type tests on one per type per size air filters for the following properties.
- a) Gravimetric efficiency.
 - b) Pressure drop in clean & dirty (choked - %age to be specified) condition.
 - c) Efficiency as per BS EN - 779.
- 4.3 Verification of type test certificates for similar type & size of filters for sodium flame test as per BS-3928 (if applicable- refer data sheet).



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

SHEET 4 OF 4

5. DATA TO BE FURNISHED BY VENDOR AFTER AWARD OF CONTRACT

- 5.1 GA Drawing.
- 5.2 Drawing showing material/construction detail
- 5.3 Installation and service manual
- 5.4 Rating curves/charts
- 5.5 Test certificates
- 5.6 Elect. diagrams (when automatic cleaning type)



**AIR FILTER
DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 1

DESCRIPTION

DATA

1) General

- | | |
|------------------------------|--|
| 1.1 Service | : Air Conditioning. |
| 1.2 Location | : Central Air conditioning plant, & package AC plant, fresh air fan system. Also for split AC. |
| 1.3 Nos. | : Refer Section 'C' of Specification. |
| 1.4 Total air flow/type | : Refer Section 'C' of Specification. |
| 1.5 Temperature | : As per project information. |
| 1.6 Relative Humidity | : 100% |
| 1.7 Gas Composition | : Atmospheric Air (Dusty) as prevalent in power Station. |
| 1.8 Filter Media | : Synthetic non-woven |
| 1.9 Efficiency | : Average arrestance efficiency of 65-80 % for Dry Panel filter (pre-filters) and average arrestance Efficiency of 80-90 % for fine filters. |
| 1.10 Allowable pressure drop | : 2.5 mm & 6.5 mm in clean and dirty condition respectively for dry panel filters(prefilters).
12 mm in clean condition for fine filters. |
| 1.11 Frame Work | : 18 G, GSS. |
| 1.12 Mounting | : Ladder Type M.S Angles (galvanised) |
| 1.13 Size | : 600 x 600 mm |

Note:-

- 1) Face velocity of air across the filters shall not exceed 2.5 m/sec.



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
THERMAL INSULATION FOR COLD SURFACES**



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

SHEET 2 OF 6

1. SCOPE

This specification covers design, manufacture, testing at manufacturers works, supply, application & finishing of insulation for cold piping, air conditioning ducting & equipment for low temperature service.

2. CODES & STANDARDS

The design, manufacture and performance of materials covered under this specification shall comply with all currently applicable statues, regulations & safety codes in the locality where the equipment/material are to be installed. The material shall also conform to the latest applicable Indian/British/American codes & standards. Nothing in this specification shall be construed to relieve the vendor of his responsibility. In particular, the material shall conform to the latest editions of the following standards :-

IS:3069: GLOSSARY OF TERMS & SYMBOLS & UNITS RELATING TO THERMAL INSULATION

materials.

2.1 IS:4671 : Expanded polystyrene for thermal insulation purposes.

2.2 IS:3677 : Mineral wool for thermal insulation.

2.3 IS:8183 : Resin bonded mineral wool.

3. DESIGN REQUIREMENTS

3.1 The insulating material as well as protective covering shall be new & unused, non-corrosive, vermin/rodent proof and shall be guaranteed to withstand continuously & without deterioration the maximum/minimum temperatures to which they may be subjected to, under specified site conditions.

3.2 The insulation material must be light weight, strong, free from shots & coarse fibre & shall provide high insulation efficiency at low weight & coat. It should be non-hygroscopic & should not rot. It shall not settle or shake down even when subjected to prolonged vibrations.

3.3 The insulation material, density and thickness etc. Shall be as specified in DATA SHEET A.

4. APPLICATION DETAILS

4.1 The surface to be insulated shall be thoroughly cleaned and allowed to dry. Pressure/hydrostatic tests, if any, shall be carried out before application of insulation.

4.2 A layer of solvent free, anticorrosive paint shall be applied & allowed to dry.

4.3 Hot industrial bitumen of grade 85/40 or 85/25 conforming to latest IS:702 shall be uniformly applied @ 1.5 kg/sq.m on the surface to be insulated. A similar layer shall also be applied on the inside surface & edges of the insulation. A suitable cold adhesive compound may also be used in place of bitumen.

4.4 Insulation in the form of pipe sections/rolls slabs of specified density & thickness shall be stuck to the coated surface with joints staggered & well butted & secured. The adjoining sections shall be tightly pressed together. All the joints shall be sealed with



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

SHEET 3 OF 6

bitumen/equivalent adhesive. Voids if any shall be packed with suitably cut pieces of insulation material.

- 4.5 In case of double layer application both circumferential & longitudinal joints shall be suitably staggered.

5. VAPOR SEALING & INSULATION FINISH

The insulation shall be treated for vapor sealing & weather proofing & finished as specified in DATA SHEET A The acceptable types of finishes are outlined below:-

5.1 FINISHING SYSTEM I: EXTERNAL INSULATION WITH PLASTER FINISH

- 5.1.1 A thick vapor seal of hot bitumen @ 2.5 kg/Sqm shall be applied on the outer surface of insulation & allowed to dry.
- 5.1.2 The surface shall then be wrapped with 20mm (3/4" hexagonal mesh of 24 SWG GI wire, butting all the joints & laced down with 22 SWG GI lacing wire.
- 5.1.3 12.5mm (1/2 inch) thick sand cement plaster in the ratio of (1:1) shall be applied in two layers, the second layer being brought to a smooth finish. A water proofing compound shall be added to the cement before its application.

5.2 FINISH SYSTEM II: EXTERNAL INSULATION WITH PLASTER FINISH OVER POLYTHENE.

- 5.2.1 The insulation shall be covered with 500 g polythene/polythene bonded Hessians (PBH) with 50mm overlap on longitudinal & circumferential joints. Overlaps shall be sealed with synthetic adhesive in case of polythene & liberal coat of bitumen in case of PBH:
- 5.2.2 The surface shall then be wrapped with 20mm (3/4") mesh of 24 SWG GI wire butting all the joints & laced down with 22 SWG GI lacing wire.
- 5.2.3 12.5mm thick (1/2 inch) sand cement plaster in ratio of(4:1) shall be applied in two layers, the second layer being brought to a smooth & even finish similarly as described above.

5.3 FINISH III:EXTERNAL INSULATION WITH SHEET METAL FINISH

- 5.3.1 The insulation shall be covered with 500g polythene with 50mm overlaps at joints which shall be sealed with synthetic adhesive or equivalent compound.
- 5.3.2 The polythene shall be covered with 24 gauge GI/aluminum sheet
- 5.3.3 25mm wide x 22 SWG GI/aluminum peripheral straps shall be fixed over the GI/aluminum sheet at 300mm centres to secure.

5.4 FINISH IV: EXTERNAL INSULATION WITH PLASTER & WATER PROOFING COMPOUND

For ducts & piping exposed to atmosphere, the finish shall be as follows:

- 5.4.1 A thick vapor seal of hot bitumen at 2.05 kg/sq.m shall be applied on the outer surface of insulation & allowed to dry.
- 5.4.2 The surface shall then be wrapped with 20mm (3/4") hexagonal mesh of 24 SWG GI Wire butting all the joints & laced down with 22 SWG GI lacing wire.
- 5.4.3 12.5mm thick (1/2 inch) sand cement plaster in ratio of (4:1) shall be applied in two layers, the second layer being brought to a smooth finish with water proofing compound added to the cement.



TECHNICAL SPECIFICATION

THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08


VOLUME II B

SECTION D

SHEET 4 OF 6

5.4.4

3 mm (1/8") thick coat of water proofing compound shall be applied & wrapped with fibre glass RP tissue. A final coat of 3mm thick water proofing compound shall then be applied over the fiberglass RP tissue & allowed to dry. Alternatively, in place of water proofing as desired above, tar felt type 3 grade 1 of IS 1322 with joints overlapped by 75mm shall be fixed & sealed with bitumen & over this 24 SWG. 25mm hexagonal GI mesh shall be fixed with 22 swig. GI lacing wire & finally bitumen paint shall be applied over wire netting.

	TECHNICAL SPECIFICATION THERMAL INSULATION FOR COLD SURFACES	SPECIFICATION NO.PES-553-08
		VOLUME II B
		SECTION D
		SHEET 5 OF 6

6. INSULATION OF PUMPS & VALVES

- 6.1 For all inspection covers & hatches on equipment, pump casing & valve bodies, flanges etc. the insulation shall be applied such as to facilitate removal with minimum damage to the insulation. This shall be achieved by encasing the insulation in 22 gauge aluminum sheet metal boxes, which shall be bolted together around the equipment to permit easy removal & replacement. Proper care shall be taken to maintain continuity of vapor seal between the static & removable partitions of the insulation.
- 6.2 The tenderer may offer thickness of insulation & finishes other than that specified in DATA SHEET A. However, calculations/reasons in support of alternative proposal shall be furnished for purchaser's approval.

7. INSPECTION & TESTING (REFER SPEC. NO - PES-553.00)

- 7.1 All necessary tests, as required to ensure that the material supplied conform to the requirements of applicable codes & standards, shall be carried out at manufacturer's works & test certificates including these for material/accessories shall be furnished for purchasers approval.

8. PAINING

- 8.1 Pipe work having insulation & cladding shall be provided with color identification for the fluids handled and for indicating direction of flow.
- 8.2 Equipment surfaces having insulation and cladding shall also have identification numbers and any other relevant data provided on the insulated surface.
- 8.3 All painting for insulated surfaces shall conform to the requirement specified elsewhere.



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

SHEET 6 OF 6

- 9. DATA TO BE FURNISHED AFTER AWARD OF CONTRACT**
- 9.1 Final version of data sheet 'B' incorporating changes if any along with design data.
- 9.2 Test certificates/reports giving result of insulation to ensure conformance to applicable codes & standards & in particular the following:-
- a) Thermal conductivity test.
 - b) Sound absorption coefficient test.
 - c) Corrosion test.
 - d) Sulphur content, moisture content, shot content, moisture absorption etc.
 - e) Compressive strength & cross breaking strength test.
- 9.3 Sketches/technical literature/sectional drgs. indicating insulation materials finish and method of application etc.
- 9.4 Manual dealing with safety aspects & instructions for combating fire arising out of insulation work.
- 9.5 Instructions on maintenance of insulation work.



THERMAL INSULATION
FOR COLD SURFACE
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

SHEET 1 OF 1

Insulation Material

Insulation	Code	Thermal Conductivity MW/cm ⁰ C	Density Kg/m ³
Resin bonded mineral wool / glass wool	IS:8183	0.49 at 50 ⁰ C	At least 24 for duct insulation and 48 for acoustic lining.
Mineral Wool Pipe Section (min. Gr.2)	IS:9842	0.43 at 50 ⁰ C	At least 81
Expanded Polystyrene	IS:4671	0.37 at 10 ⁰ C	At least 15

Type of Insulation

S.No.	Surface	Insulation Material	Insulation Form	Thickness (mm)
i)	Supply & Return air duct for air-conditioning system	Resin bonded roll Mineral Wool (IS:8183)		25
ii)	Refrigerant Piping	a) Expanded Polystyrene	Pipe Section	75
		or b) Mineral Wool	Pipe Section	75
iii)	AHU drain pipe	a) Expanded Polystyrene	Pipe Section	25
		or b) Mineral Wool	Pipe Section	25
iv)	AHU drain pan coil section and fan section	a) Expanded Polystyrene	Slabs	25
		or b) Mineral Wool	Slabs	25
v)	Chilled water piping, valves & specialties	a) Expanded Polystyrene	Pipe Section	75
		or b) Mineral Wool	Pipe Section	75
vi)	Chiller	a) Expanded Polystyrene	Slabs	100
		or b) Mineral Wool	Slabs	100
vii)	Chilled Water Pumps	a) Expanded Polystyrene	Slabs	50
		or b) Mineral Wool	Slabs	50
viii)	Expansion tank with pipe	a) Expanded Polystyrene	Slabs/Pipe Section	50
		or b) Mineral Wool	Slabs/Pipe Section	50



AIR CONDITIONING SYSTEM

LIST OF MAKES OF SUB-VENDOR ITEMS

**SECTION-I
SUB SECTION -E**

LIST OF MAKES OF SUB-VENDOR ITEMS

Package Name	Generic classification	Sub-Class	Type	Supplier Name	Supplier Communication Address	Tech Limit
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	JOHNSON		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	BELIMO		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	SIEMENS LIMITED	Dr. Armin Bruck/Sandeep Mathur 130, Pandurang Budhkar Marg Worli Mumbai Phone- 0124 383 7377 Pincode : 400018 Email : ankit.varshney@siemens.com	
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	RAPID CONTROL		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	ALC		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	LIMITORQUE		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	AUMA		
ACTUATOR FOR MOTORIZED BUTTERFLY VALVE	Mechanical	Valve	actuator	Honeywell Automation India Limited	Mr. Ritwij Kulkarni 917, INTERNATIONAL TRADE TOWER, NEHRU PLACE, NEW DELHI Phone- 9890200584 Pincode : 110019 Email : rajesh.chaudhary@honeywell.com	
Air Blowers(twin Lobe)	mechanical	air blower	twin lobe	Everest Blowers Pvt. Ltd.	B-44, Block B, Mayapuri Industrial Area Phase I, New Delhi, Delhi 110064 011 4545 7777	
Air Blowers(twin Lobe)	Mechanical	blower	twin lobe	Swam Pneumatics	C-2,SECTOR-3,NOIDA-201301,(U.P.) INDIA. Telephone: +91-120 - 469 6222 FAX: +91-120 - 244 3282 E-mail: sales@swamatics.com Website: www.swamatics.com	
Air Blowers(twin Lobe)			twin lobe	Kay International Limited	Palla road dahisara villege Sonipat dahisara, Sonipat, Haryana 131028 91-8572899447 Send SMS	
air blowers(twin lobe)	blower	air	twin lobe	KPT LTD	Shirol - 416 103, Dist : Kolhapur, Maharashtra, INDIA. Telephone +91-231-2689900 Fax +91-231-2689946 Website www.kpt.co.in CIN L29130MH1976PLC019147 E-mail support@kpt.co.in	
AIR COOLED CONDENSER	Mechanical	Condenser	Air Colled	Beijing Longyuan Cooling Technology Co., Ltd (BLCT)	No.11 Tongji South Road, Economic & Technological Development Area, Beijing, Beijing Phone- 0086-10-87859981 Pincode : Email : zhaoji@bjlyq.com.cn	
AIR FILTER	Mechanical	Filter	Air	TENACITY		
AIR FILTER	Mechanical	Filter	Air	JOHN FOWLER		
AIR FILTER	Mechanical	Filter	Air	ANFILCO		
AIR FILTER	Mechanical	Filter	Air	PUROMATIC		
AIR FILTER	Mechanical	Filter	Air	SPECTRUM		
AIR FILTER	Mechanical	Filter	Air	AIR TECH		
AIR FILTER	Mechanical	Filter	Air	FMI		
AIR FILTER	Mechanical	Filter	Air	PURULATOR		
AIR HANDLING UNITS	Mechanical	package	AHU	ZECO		
AIR HANDLING UNITS	Mechanical	package	AHU	CARRAIRE(FLAKT)		
AIR HANDLING UNITS	Mechanical	package	AHU	BLUE STAR LIMITED	Jamshedji Tata Road, Mumbai - 400 020 Phone: (91) (22) 6665 4000 Fax: (91) (22) 6665 4151 www.bluestarindia.com Corporate Headquarters	
AIR HANDLING UNITS	Mechanical	package	AHU	VOLTAS	Voltas Limited Voltas House 'A' Block Dr. Babasaheb Ambedkar Road Chinchpokli	
AIR HANDLING UNITS	Mechanical	package	AHU	ETHOS		
AIR HANDLING UNITS	Mechanical	package	AHU	WAVES AIRCON		
AIR HANDLING UNITS	Mechanical	package	AHU	SYSTEM AIR		
AIR HANDLING UNITS	Mechanical	package	AHU	EDGETECH		
AIRCONDITIONING SYSTEM	Package			GEMINI SHREEWAS (ENGINEERS) PVT. LTD.	Mr. S. Ramasamy No. 287C, NP, 11th Street Sidco Industrial Estate, Ambattur Chennai Phone- 044-26256011 Pincode : 600 098 Email : contact@geminishreewas.com	
AIRCONDITIONING SYSTEM	Package			VOLTAS LTD.	PUMPS DIVISION, P.O.BOX-72, VOLTAS HOUSE, 19, J.N.HERDIA MARG, BALLARD ESTATE, MUMBAI Phone- 22614715 Pincode : 400038 Email : ljha@voltas.com	

Package Name	Generic classification	Sub-Class	Type	Supplier Name	Supplier Communication Address	Tech Limit
AIRCONDITIONING SYSTEM	Package			ADVANCE VENTILATION PVT.LTD.	SUMIT CHAUDHARY, 610, PP Towers, C1,2&3 PP Towers, Netaji Subhash Place, Pitampura, New Delhi, Phone- 0130-2219092-96, Pincode : 110034, Email : sales@advanceventilation.com,	
AIRCONDITIONING SYSTEM	Package			INDUSTRIAL PROJECT & PRODUCTS CO.	Mr. Surinder Singh, Plot No. 61, Block-7 Ward No.1,behind gyandeep school, Near sector-5 Gurgaon Phone- 8510044695 Pincode : 122001 Email : industrialppc.1@gmail.com	
AIRCONDITIONING SYSTEM	Package			STERLING AND WILSON PRIVATE LIMITED	PREMISES NO. GN-31, 2nd & 3rd FLOOR, SECTOR-5, SALT LAKE, KOLKATA-700091, KOLKATA, Phone- 9007042713 Pincode : 700091 Email : Swarup.mukherjee@sterlingwilson.com	
AIRCONDITIONING SYSTEM	Package			ROOTS COOLING SYSTEMS PVT. LTD.	Mr. Pradeep Choudhary B-53,HOSIERY COMPLEX, PHASE-II NOIDA Phone- 098109-03848 Pincode : 201305 Email : rcspower@rootsdek.com	
ALUMINIUM SHEETS/COILS	Mechanical			Chongqing Lanren Aluminium Co. Ltd., China	Apev No. 1, Yatai Road, Nanaping Nanan District Chongqing Phone- Pincode : 400060 Email :	
ALUMINIUM SHEETS/COILS	Mechanical			BHARAT ALUMINIUM COMPANY LTD	BALCO Township, P.O. : BALCO Township, Korba Korba Phone- Pincode : 495684 Email : sk.sharma@vedanta.co.in	
ALUMINIUM SHEETS/COILS	Mechanical			JINDAL ALUMINIUM LIMITED	Mr. Abhay Vishwakarma Jindal Nagar, Tumkur Road Bengaluru Phone- 080-23715555 Pincode : 560073 Email : abhay@jindalaluminium.com	
ALUMINIUM SHEETS/COILS	Mechanical			NATIONAL ALUMINIUM COMPANY LTD.	NALCO BHAVAN , P/1, NAYAPALLI BHUBANESWAR Phone- Pincode : 751013 Email : asahluwalia@nalcoindia.co.in	
ALUMINIUM SHEETS/COILS	Mechanical			HINDALCO INDUSTRIES LTD	CENTURY BHAWAN, 3RD FLOOR, DR ANNIE BASANT ROAD, WORLI, MUMBAI Phone- 24362516/ 227586 Pincode : 400 025 Email : ashok.j.singh@adityabirla.com	
ANALYSERS ALL TYPE	Electronics	ANALYSERS	ALL	ABB INDIA LIMITED	MR. RAJIV GOVIL 14, MATHURA ROAD, FARIDABAD Phone- 09971085678 Pincode : 121003 Email : vipin.swami@in.abb.com	
Atmospheric storage tanks	mechanical	atmospheric		Progen Systems & Technologies Limited	Add Photo Apollo Computer Education LtdHB EDUCATION AND CONSULTING SERVICES PVT LTDHB EDUCATION AND CONSULTING Triton Square, 1st Floor, Skcl Building, Unit No: C3 To C7, Thiru Vi Ka Industrial Estate, Guindy, C, Guindy, Chennai - 600032 (Map)	
Atmospheric storage tanks	Mechanical	atmospheric		Titan Engineering Company Private Limited	Indrajit Sengupta(Manager) No. 2/7, Sarat Bose Road, 5th Floor ., Sarat Bose Road , Kolkata - 700020, West Bengal, India Call Us: +91-9434009032	
Atmospheric storage tanks	mechanical	atmospheric		Rishi Industries	Address :40 L M Stone,GT Road Sonepat, Bahalgarh Road, Bahalgarh, Sonipat - 131001 , Haryana , India Contact Person :Mr. S D Bhutani (Proprietor) Phone :+91-130-2381202 Mobile :+919992555844 State:Haryana Phone:+91-1264-282801 Fax:+91-1264-282899	
Atmospheric storage tanks	Mechanical	atmospheric		Universal Heat Exchangers Ltd	Plant - I Pollachi Road Malumachampatti Post Coimbatore- 641021, India Phone - +91-(422)-2610835, 2610836 Fax - +91-(422)-2610746 Email - marketing@uniheat.com	
Atmospheric storage tanks	Mechanical	atmospheric		ATS CHEM EQUIPMENTS PVT LTD	Unit - I, C - 27, SIDCO Industrial Estate, Hosur - 635 126, Tamil Nadu, India. Phone : 04344 - 276731 MR. S.THANGARAJ Managing Director Contact No : +91 - 9443378152 Mr. S.Arumugam Director Contact No : Contact No : +91 - 9443376731 Mr. H.M.Ammar Dire	
Atmospheric storage tanks	mechanical	atmospheric		Chem Process Systems	15 Natraj Industrial Estate, Sanand-Viramgam Highway, Vasna-Iyava, Sanand - 382 170, Ahmedabad, India.+91 2717 284148- 49+91 2717 284194 chem@chemprosyst.com Mr. Sagar Desai HR Manager sagar@chemprosyst.com	